

nLIGHT 'HYBRID' BACKBONE

16500 SAMPLE LIGHTING CONTROLS SEQUENCE OF OPERATION "S.O.O."

NOTE: SAMPLE SEQUENCE OF OPERATION "S.O.O." SHOWN USED FOR REFERENCE ONLY.
IF A PROJECT SPECIFIC S.O.O. NOT PROVIDED TO 16500 IN THE E-SHEET SET
OR DIVISION 26 SPECIFICATIONS, AND IS NOT SHOWN IN THE 16500 CONTROLS
SUBMITTAL DRAWING SET, 16500 WILL ASSUME ONE IS NOT AVAILABLE AND
WILL UTILIZE THE 16500 SAMPLE S.O.O. FOR PROGRAMMING PURPOSES. IF DEVIATION
FROM THE SAMPLE S.O.O. IS DESIRED POST START-UP, PROGRAMMING, THEN ADDITIONAL
CONTROL SERVICES WILL NEED TO BE PURCHASED DUE TO
NEW PROGRAMMING INTENT.




AREA TYPE	OCCUPANCY SENSOR					TIME CLOCK		MANUAL CONTROL				DAYLIGHT		OTHER			NOTES & COMMENTS		
	AUTO ON FULL (100%)	AUTO ON PARTIAL (50-70%) [1]	MANUAL ON FULL (100%) [1]	SENSOR TIME-OUT PERIOD [2]	PARTIAL OFF (% MAY VARY)	SCHEDULED ON (BEST PRACTICE) [3]	SCHEDULED OFF	AFTERHOURS SWITCH (2-HOUR MAX)	ON/OFF ONLY	BI-LEVEL DIMMING (100%/50% OFF)	CONTINUOUS DIMMING SWITCH	INACCESSIBLE TO UNAUTHORIZED PERSONS	SCENE SWITCH [4]	CONTINUOUS DIMMING	PHOTOCELL SHUTOFF (AV, SHADE, ETC.)	PLUG LOAD INTERFACE		AUTOMATIC DEMAND RESPONSE (ADR)	CIRCADIAN RHYTHM "CCT" OR SIMILAR
EXAMPLE			X	15		X	X	X		X			X						
OPEN OFFICE		X[5]	X[5]	15		X[5]	X	X		X			X			X			
PRIVATE OFFICE OR SIMILAR [7]		X		15		X	X	X		X			X			X			
CONFERENCE		X		10			X	X		X		X	X			X			
CORRIDOR/STAIR/CIRCULATION	X			15	X		X	X	X		X								
RECEPTION LOBBY		X	X	15	X	X	X	X		X		X	X			X			
PARKING GARAGE (INTERIOR)	X			15		X	X	X			X	X	X						
STORAGE OR SIMILAR [8]		X		10			X	X	X	X	X								
WAREHOUSE	X			15	X		X	X		X				X					
WAREHOUSE AISLE	X			15	X		X	X	X					X					
COPY ROOM		X[5]		10		X[5]	X	X		X				X					
MULTI-PURPOSE ROOM		X[5]	X[5]	15		X[5]	X	X		X			X						
RESTROOM [9]	X			10/15			X	X	X			X[9]							
CLASSROOM		X	X	15			X	X		X		X	X			X			
EXTERIOR W/ PHOTOCELL ONLY					X									X					
EXTERIOR W/ TIMECLOCK ONLY					X	X		X											
EXTERIOR W/ OCCUPANCY [6]	X			15	X														
...[10]																			

NOTES:

- [1] WHERE APPLICABLE EITHER 'AUTO ON PARTIAL' OR 'MANUAL ON' MAY BE SELECTED
- [2] ALTHOUGH MAX TIMEOUT IS 20 MINUTES FOR INTERIOR, 15 MIN FOR EXTERIOR SPACES IT MAY BE BEST PRACTICE IN SELECT SPACES FOR LESS IN ORDER TO MAXIMIZE ENERGY SAVINGS
- [3] SCHEDULED ON OPERATION MAY ONLY BE APPLIED TO SPACES EXEMPT FROM OCCUPANCY SENSOR CONTROL (I.E. TIMECLOCK ONLY)
- [4] SCENE SWITCH RECOMMENDED IN SELECT SPACES BASED ON BEST PRACTICE
- [5] TITLE 24 REQUIREMENTS MAY VARY IN RESPECTIVE SPACE TYPE BASED ON SQUARE FOOTAGE (EXAMPLE: OPEN OFFICE > 7' x 200 SQFT)
- [6] OCCUPANCY SENSORS MAY BE REQUIRED IN ADDITION TO PHOTOCELL/TIMECLOCK IF MOUNTED AT OR BELOW 2' AND VOLTAGE EXCEEDS 40W
- [7] SIMILAR ROOM TYPES MAY INCLUDE PHONE ROOM, Huddle ROOM ETC.
- [8] SIMILAR ROOM TYPES MAY INCLUDE JANITOR, IT, ELECTRICAL, SINGLE-STALL, PRIVATE RESTROOM ETC.
- [9] TITLE 24 REQUIREMENTS AND DEFAULT SETTINGS MAY VARY BASED ON RESTROOM SIZE (PRIVATE, SINGLE-STALL, MULTI-STALL, ETC.)
- [10] INCLUDE ADDITIONAL SPACES/REQUIREMENTS AS NEEDED

IF COMMENTS/EDITS MADE TO TEMPLATE ABOVE PLEASE INCLUDE THE FOLLOWING:

EDITED BY				
COMPANY				
DATE				

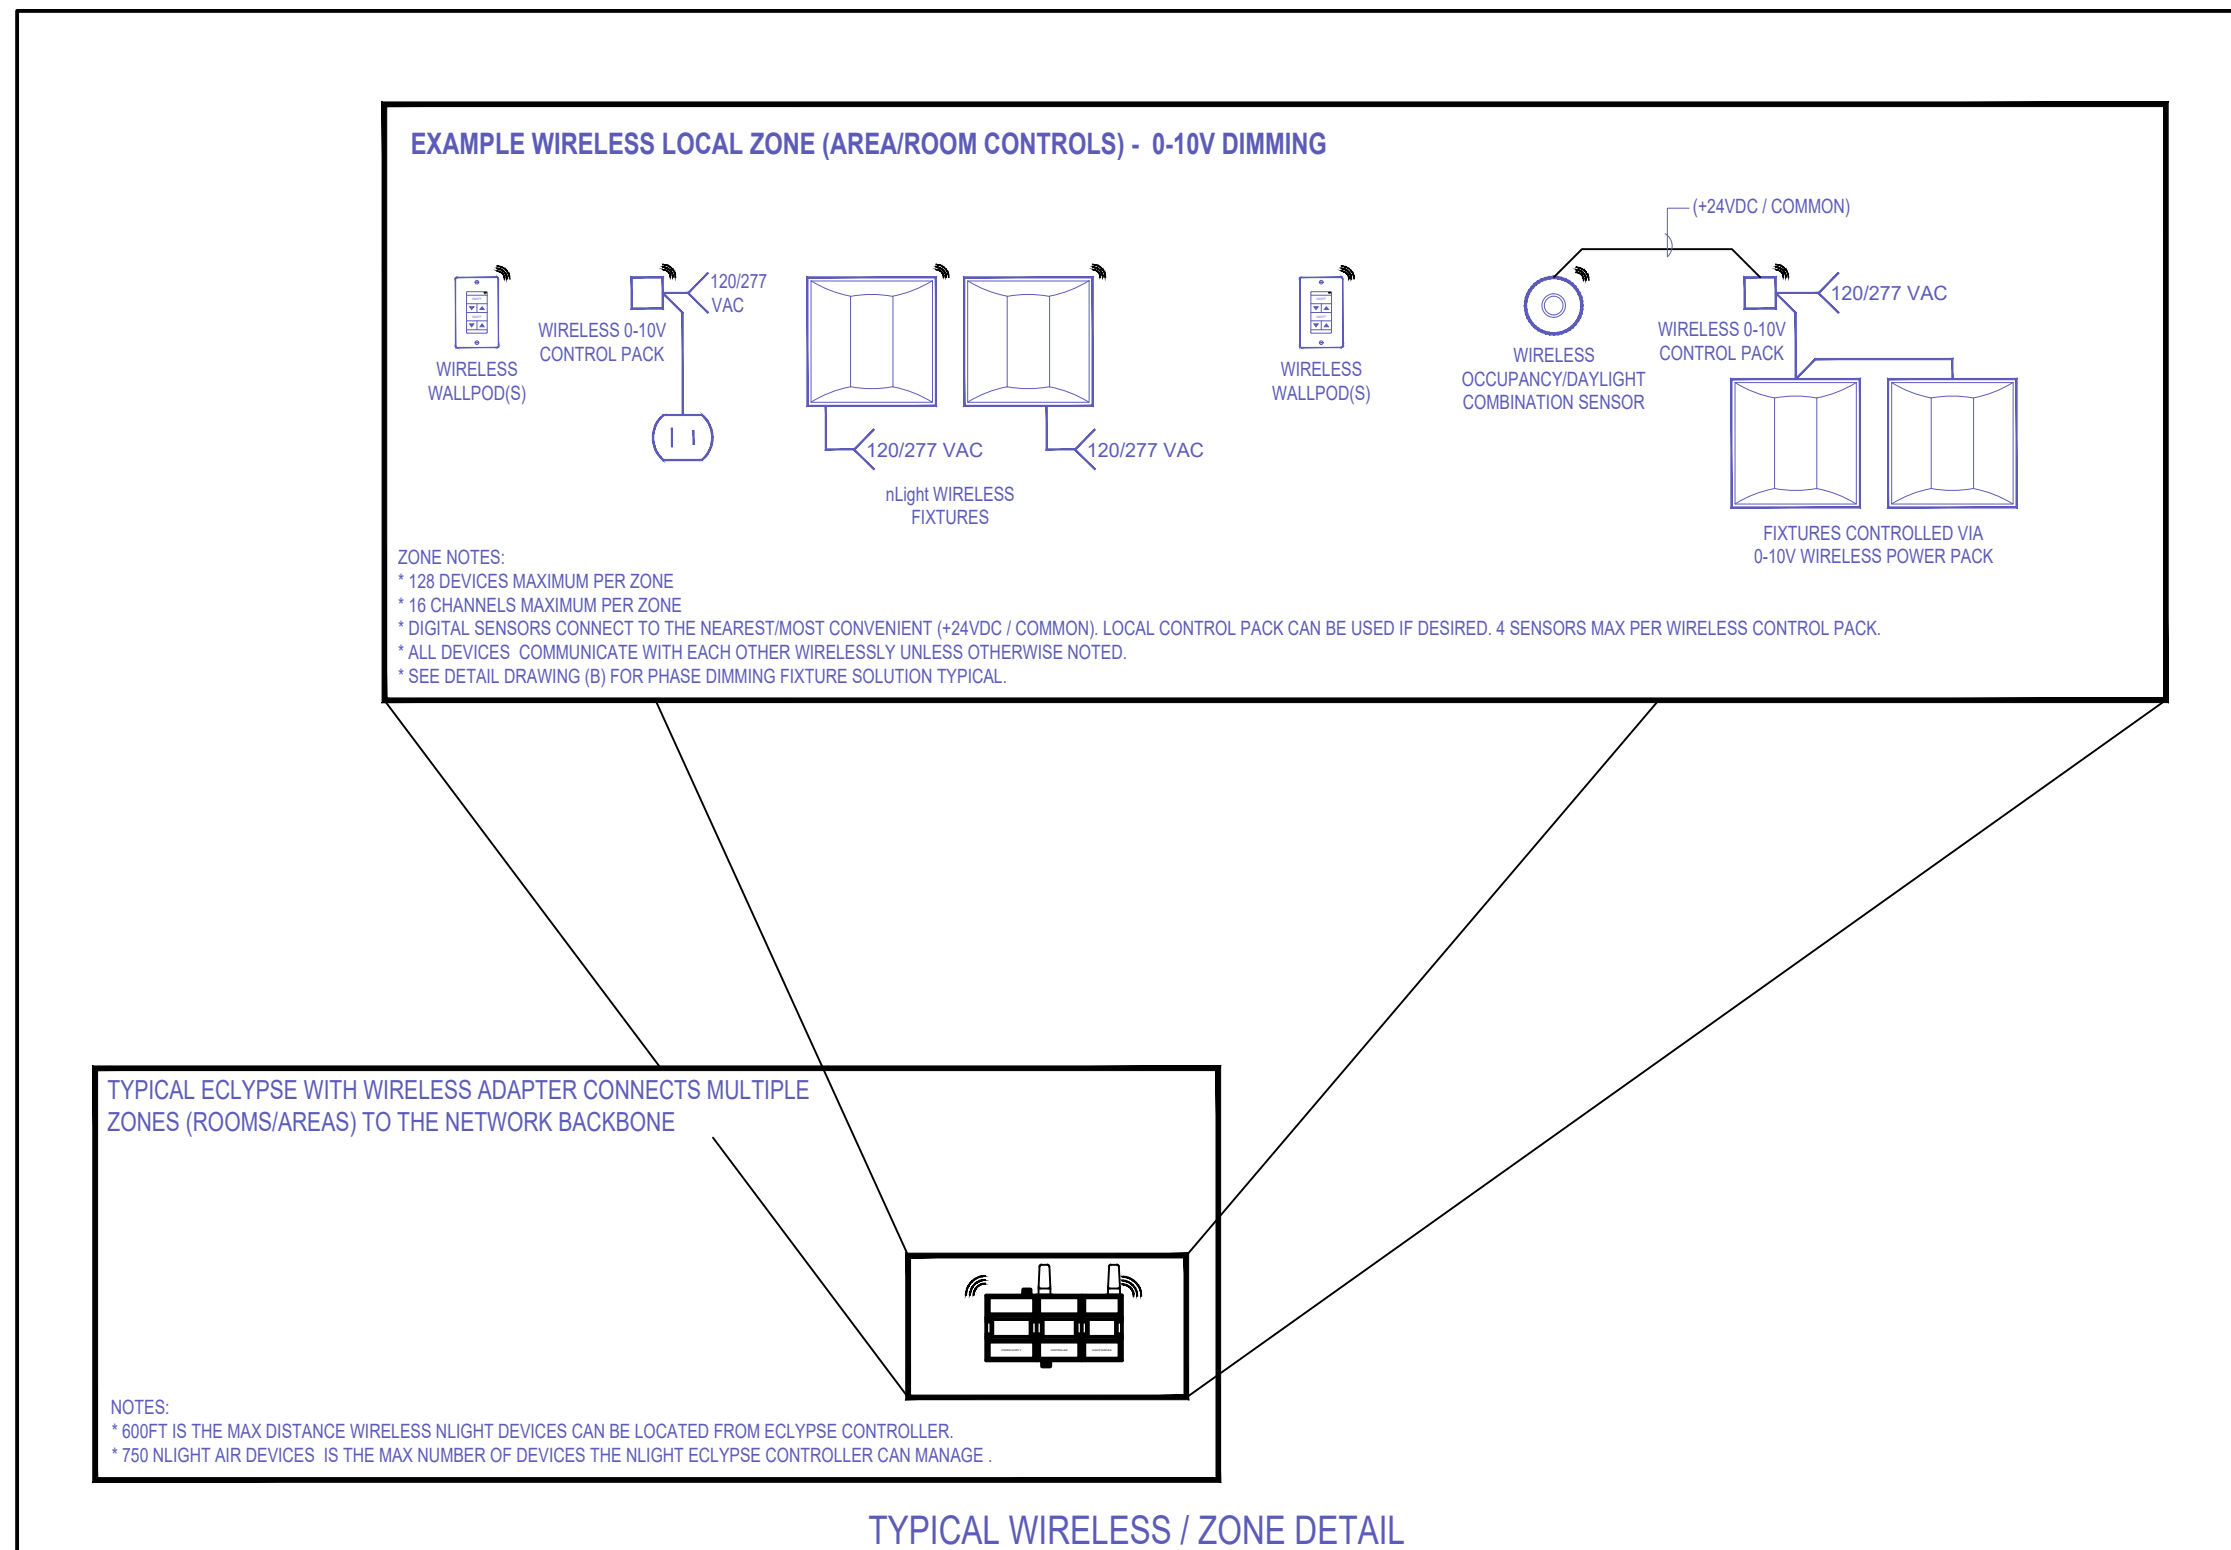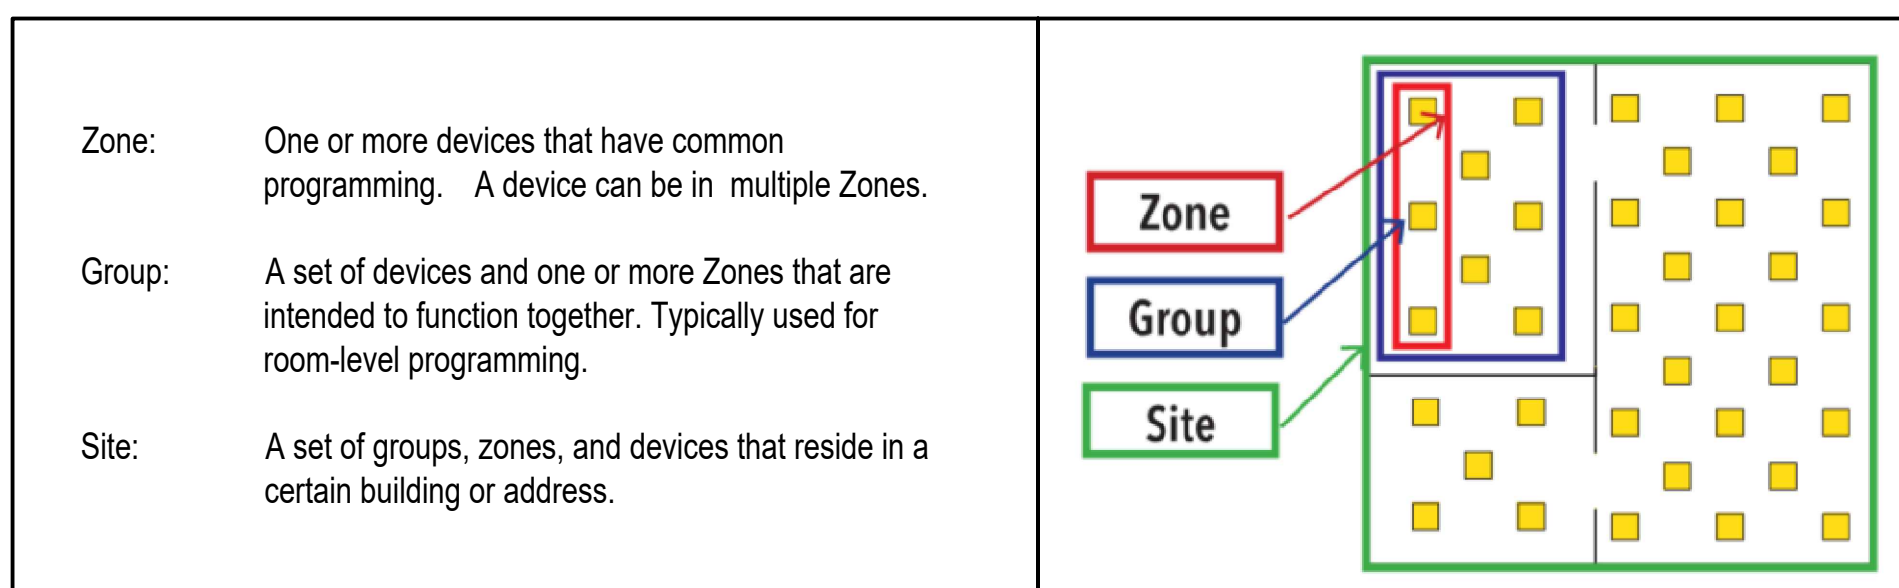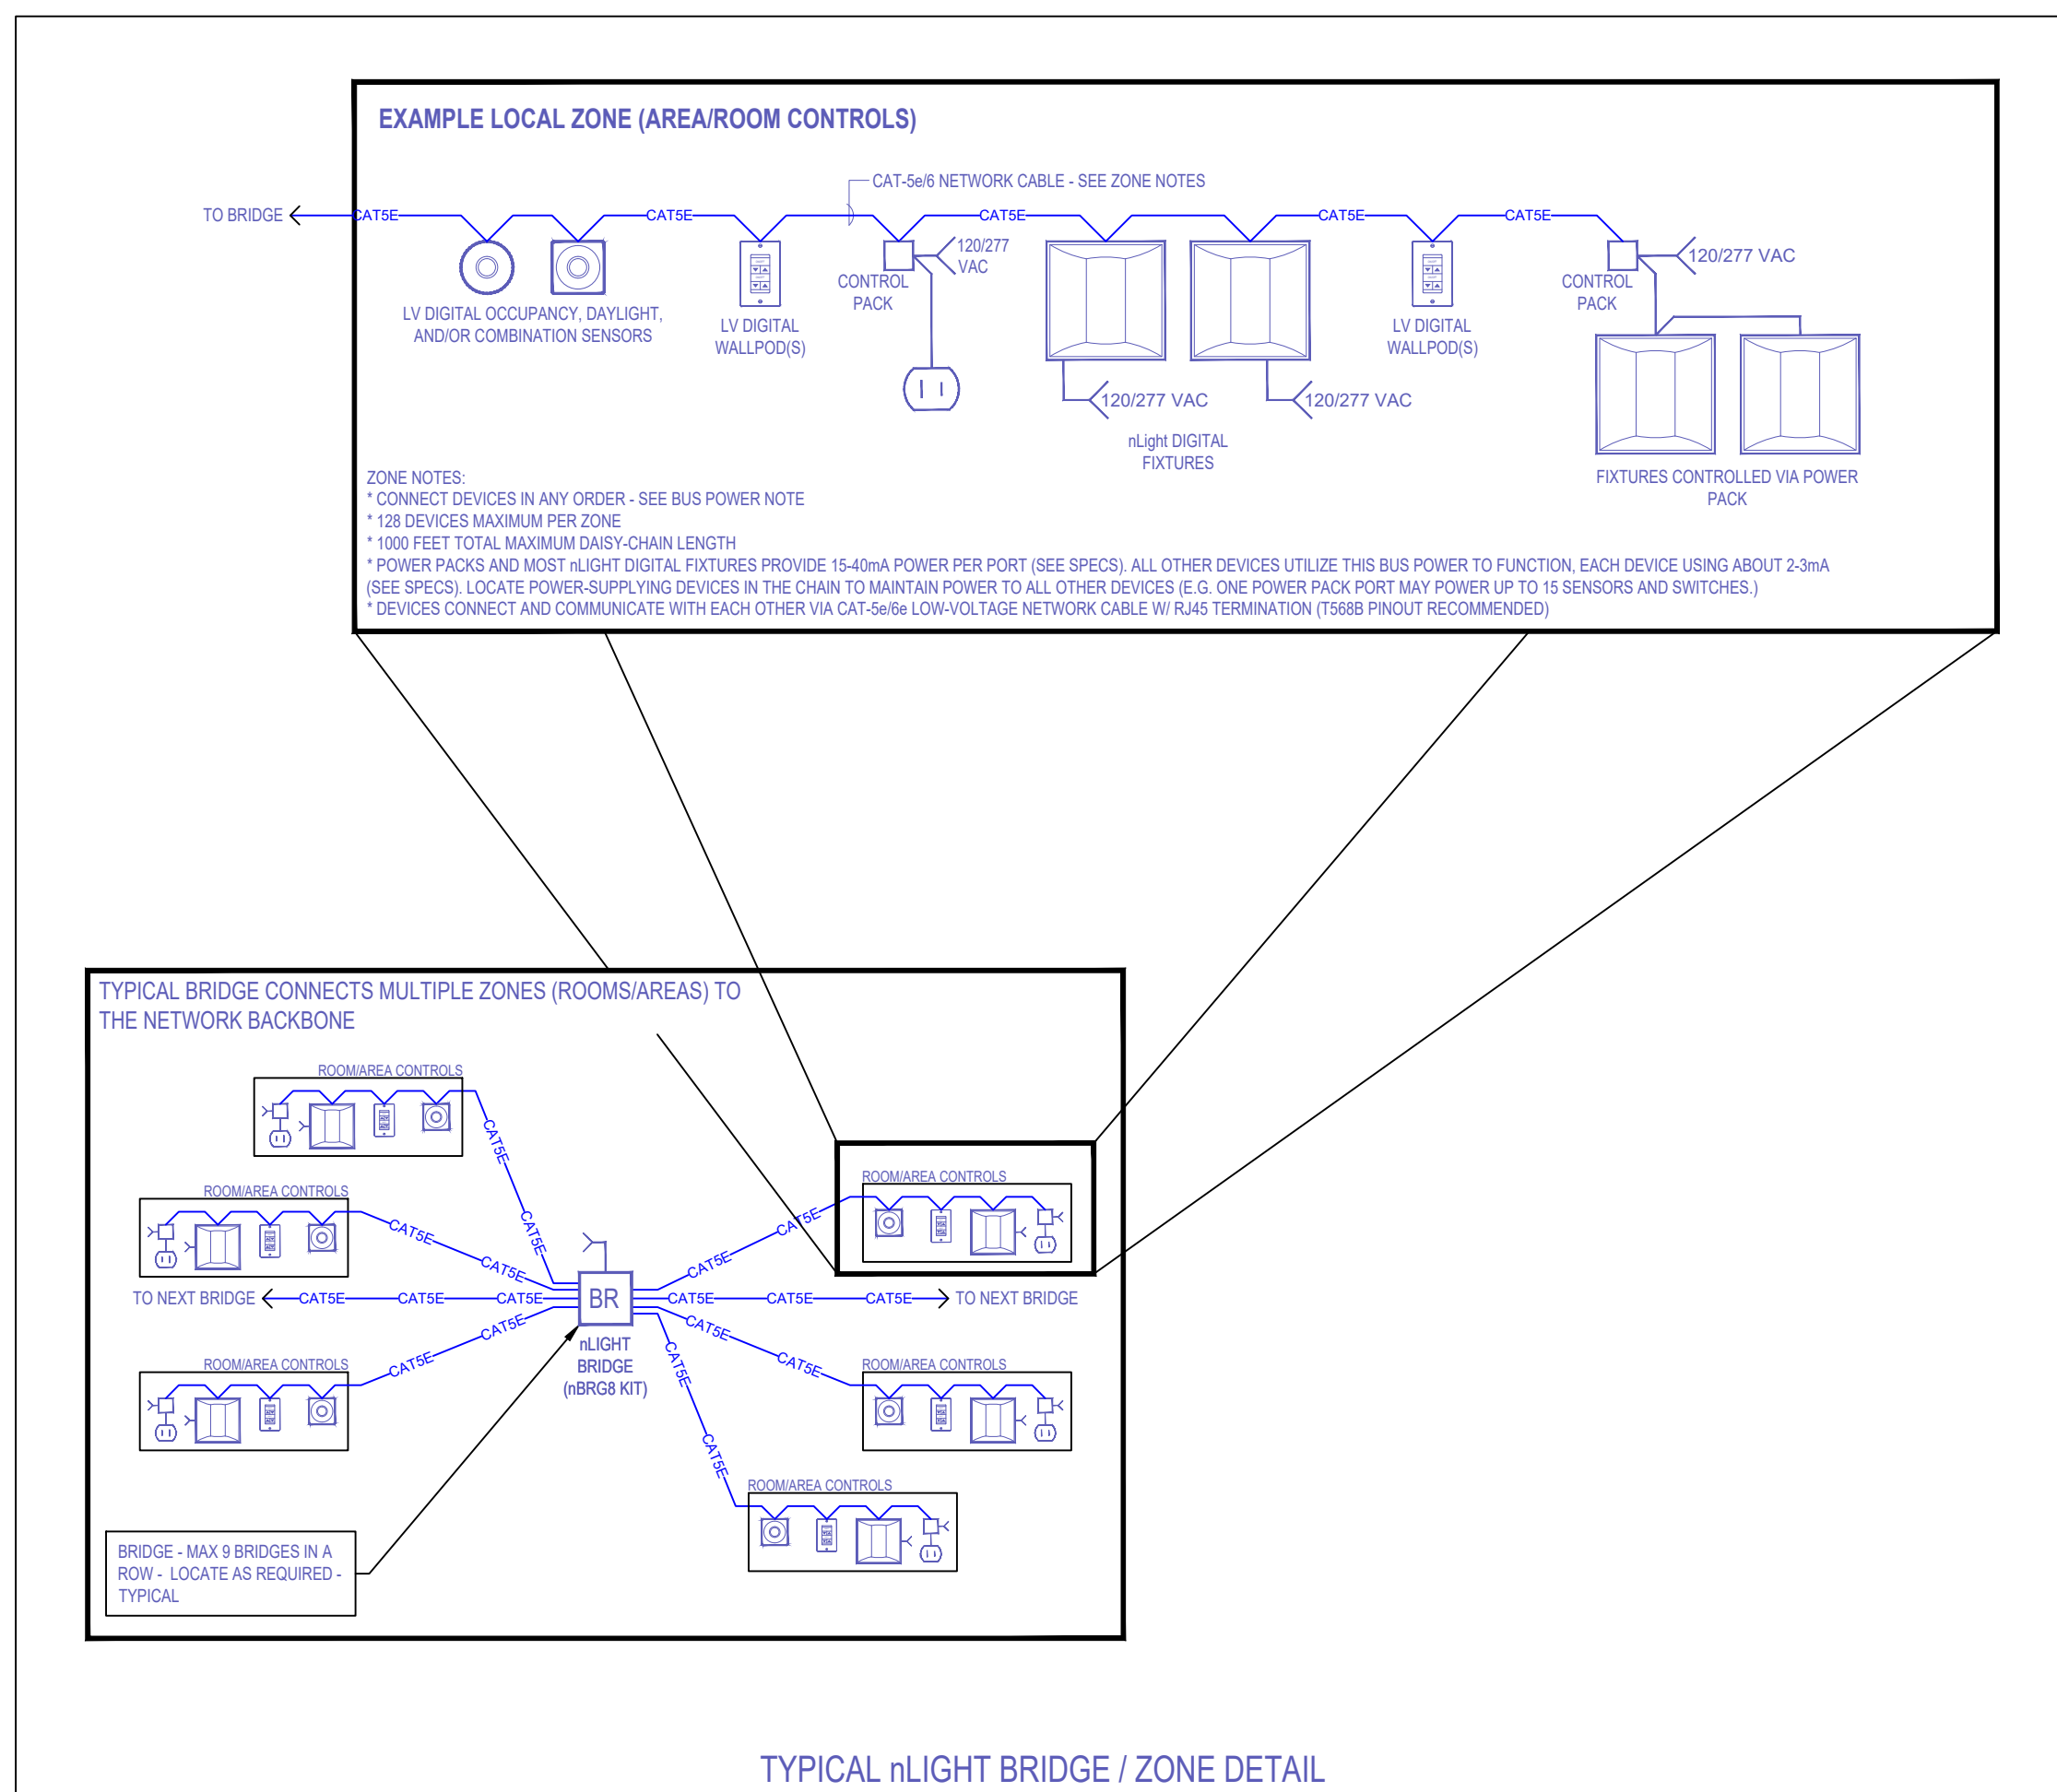

VERSION 3 ----- 08/29/2018

WIRING SUBJECT TO CHANGE AT A LATER DATE

16500 DESIGN IS ONLY FOR GENERAL CONFORMANCE WITH THE DESIGN INTENT OF THE CONTRACT DOCUMENTS. REVIEW/DESIGN SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR COMPLIANCE WITH REQUIREMENTS OF THE CONTRACT DOCUMENTS, OR FOR COORDINATION OR COMPATIBILITY WITH WORK OF OTHER TRADES, NOR FOR OMISSIONS OR NON COMPLIANCE WITH DRAWINGS OR SPECIFICATIONS, WHETHER SPECIFICALLY INDICATED IN THE DESIGN OR NOT.

ETHERNET LAN AND ACCESSORIES
(NOT INCLUDED IN PRICE / BY OTHERS)

TYPICAL nLIGHT LIGHTING CONTROL NETWORK BACKBONE - DEVICE LOCATIONS BY E.C.

16500, Inc. is an authorized agent for the manufacturers of the products shown herein. Product application recommendations are intended solely as an application and not as professional service or instruments thereof. Recommendations are based on project information provided by third parties (e.g. architect). Additional or alternate products may be required to meet actual project conditions at the time of design, quotation, order, and/or installation. For maximum accuracy, please verify and communicate all relevant application conditions prior to commitment of any kind such as design, procuring, ordering, and/or installation. 16500, Inc. is not responsible and shall not be held liable for losses/damages arising from errors and/or omissions within information provided to 16500, Inc. on which recommendations/recommendations are based. This document and all content herein, excepting only those specific portions thereof originating from a third party such as a design professional or manufacturer, are the sole property of 16500, Inc. who retains and reserves all rights therein and shall not be used and/or possessed in any way by others without express permission from 16500, Inc.

SHEET NOTES / REV

PROJECT

PREPARED FOR

DATE

WPS



sixteen5hundred
Lighting, Acoustic, Control, and Technology Solutions
510.268.6060 * info@sixteen5hundred.com * www.16500.com

PREPARED BY: **Engineer**
PRIMARY CONTACT: **Sales**

PROJECT ID: **PC# 19-XXXX**
XXXXXX@16500.com 510.645.25xx




SALES@16500.COM 510.645.25xx

nLIGHT SYSTEM DIAGRAM

LC0

ISSUE / REVISION	DATE
1. PROPOSAL	XXXXXX

Project Name
City, California

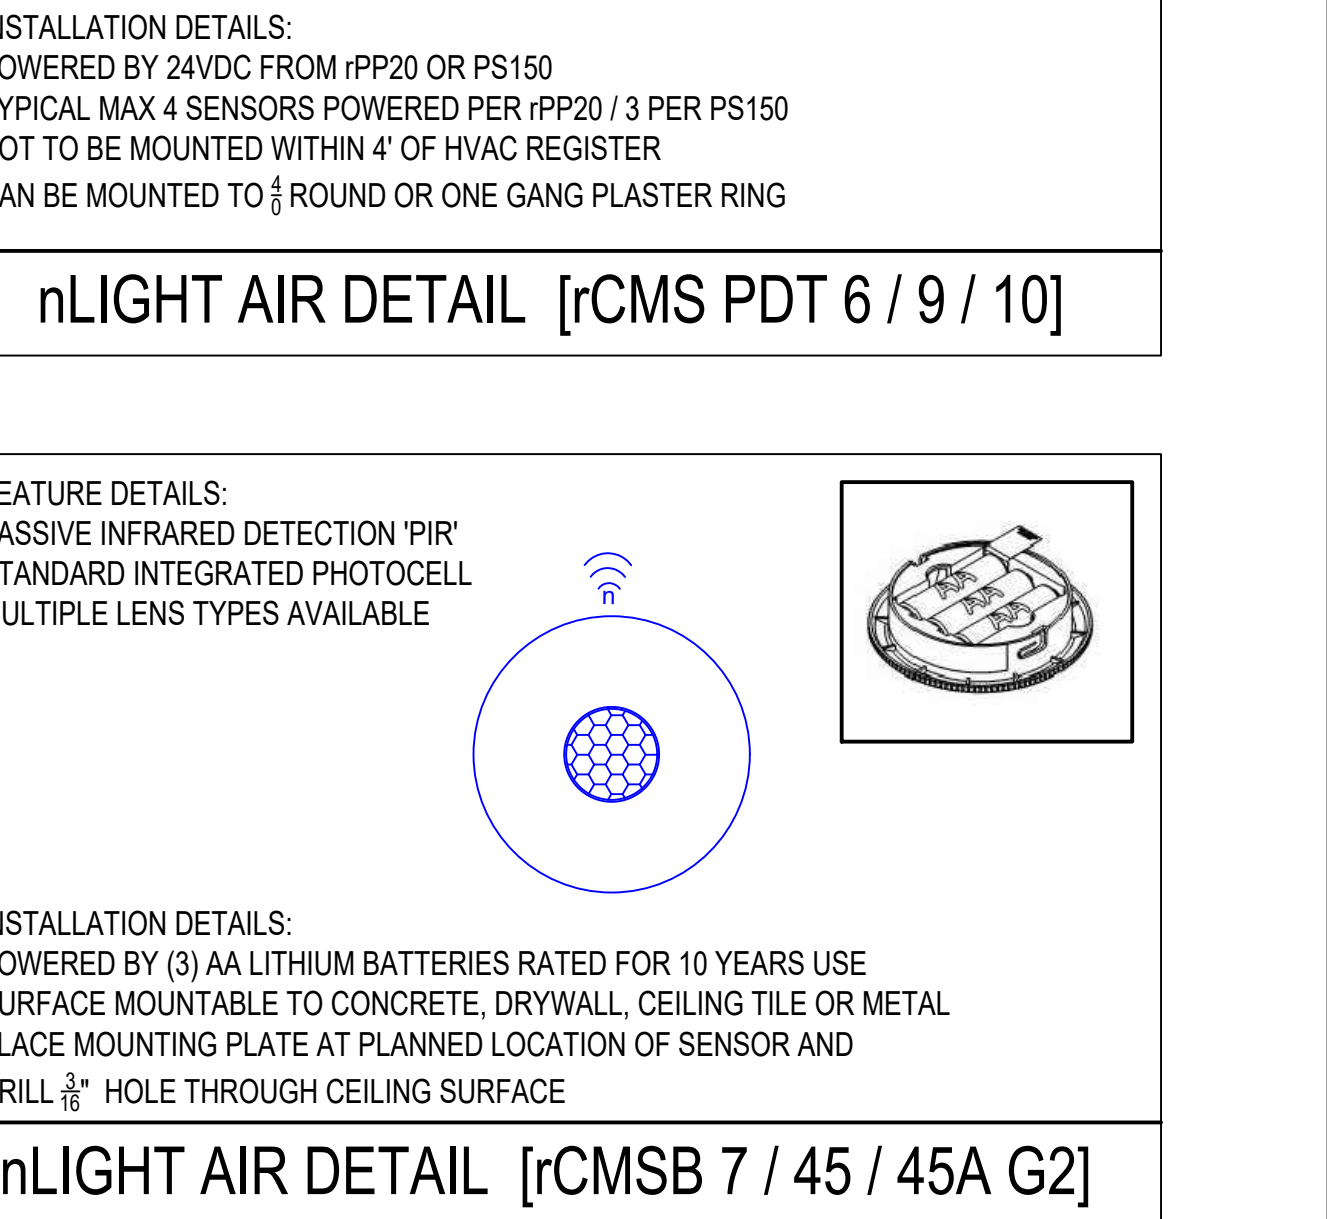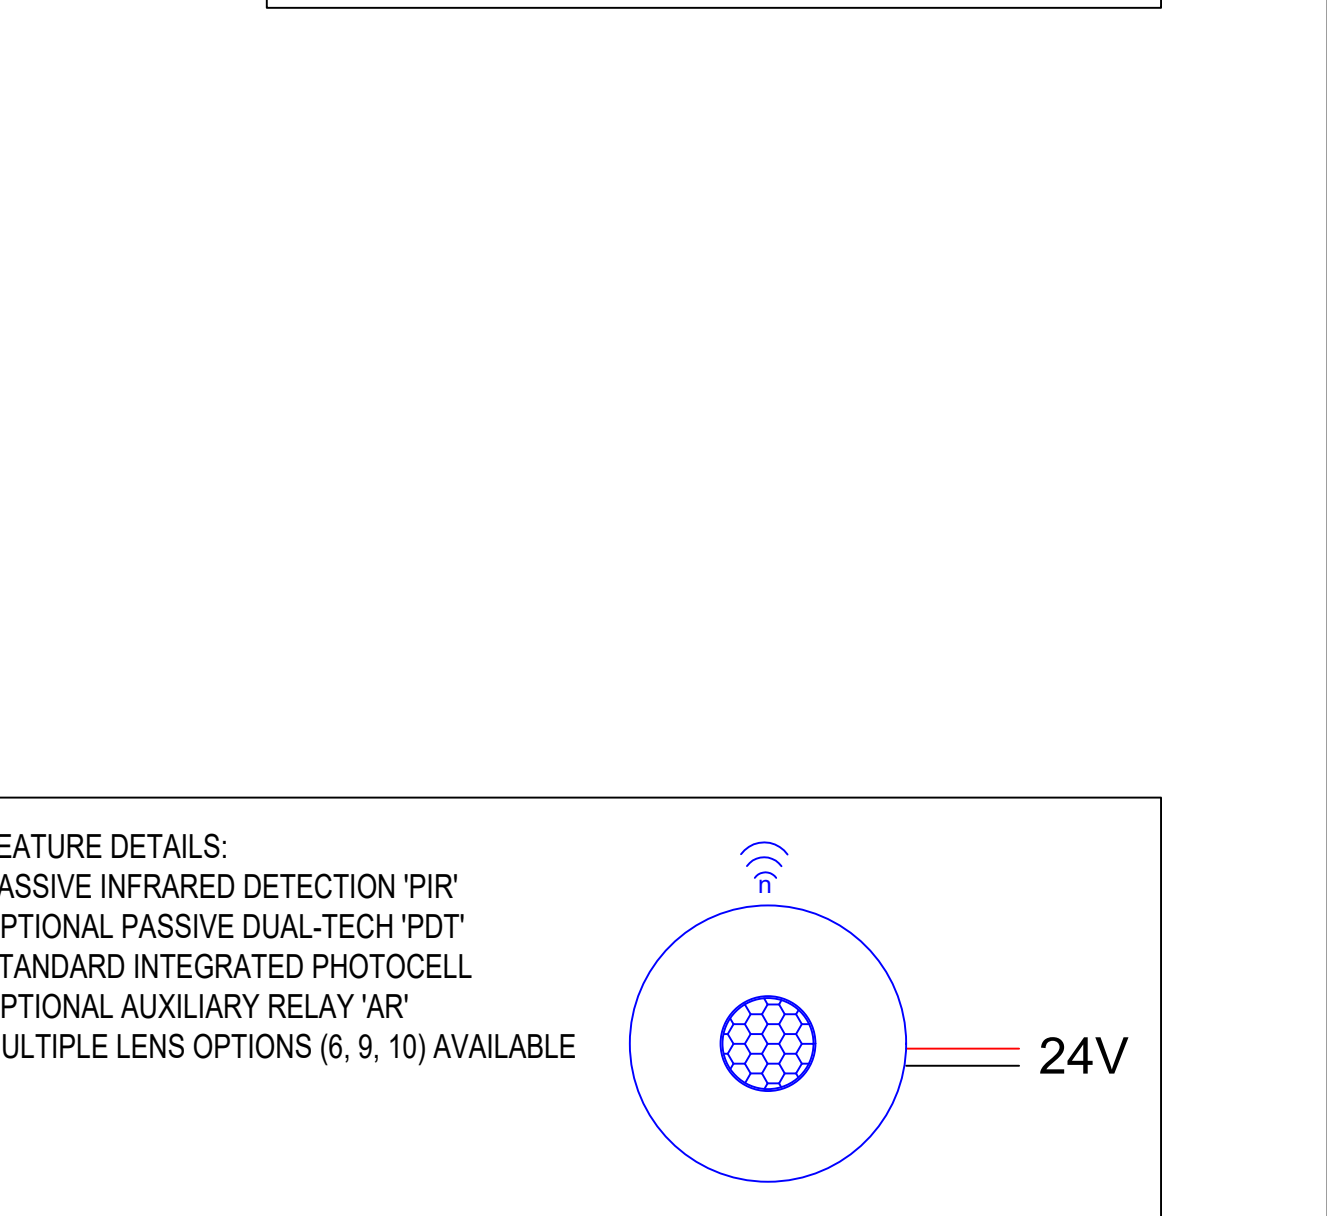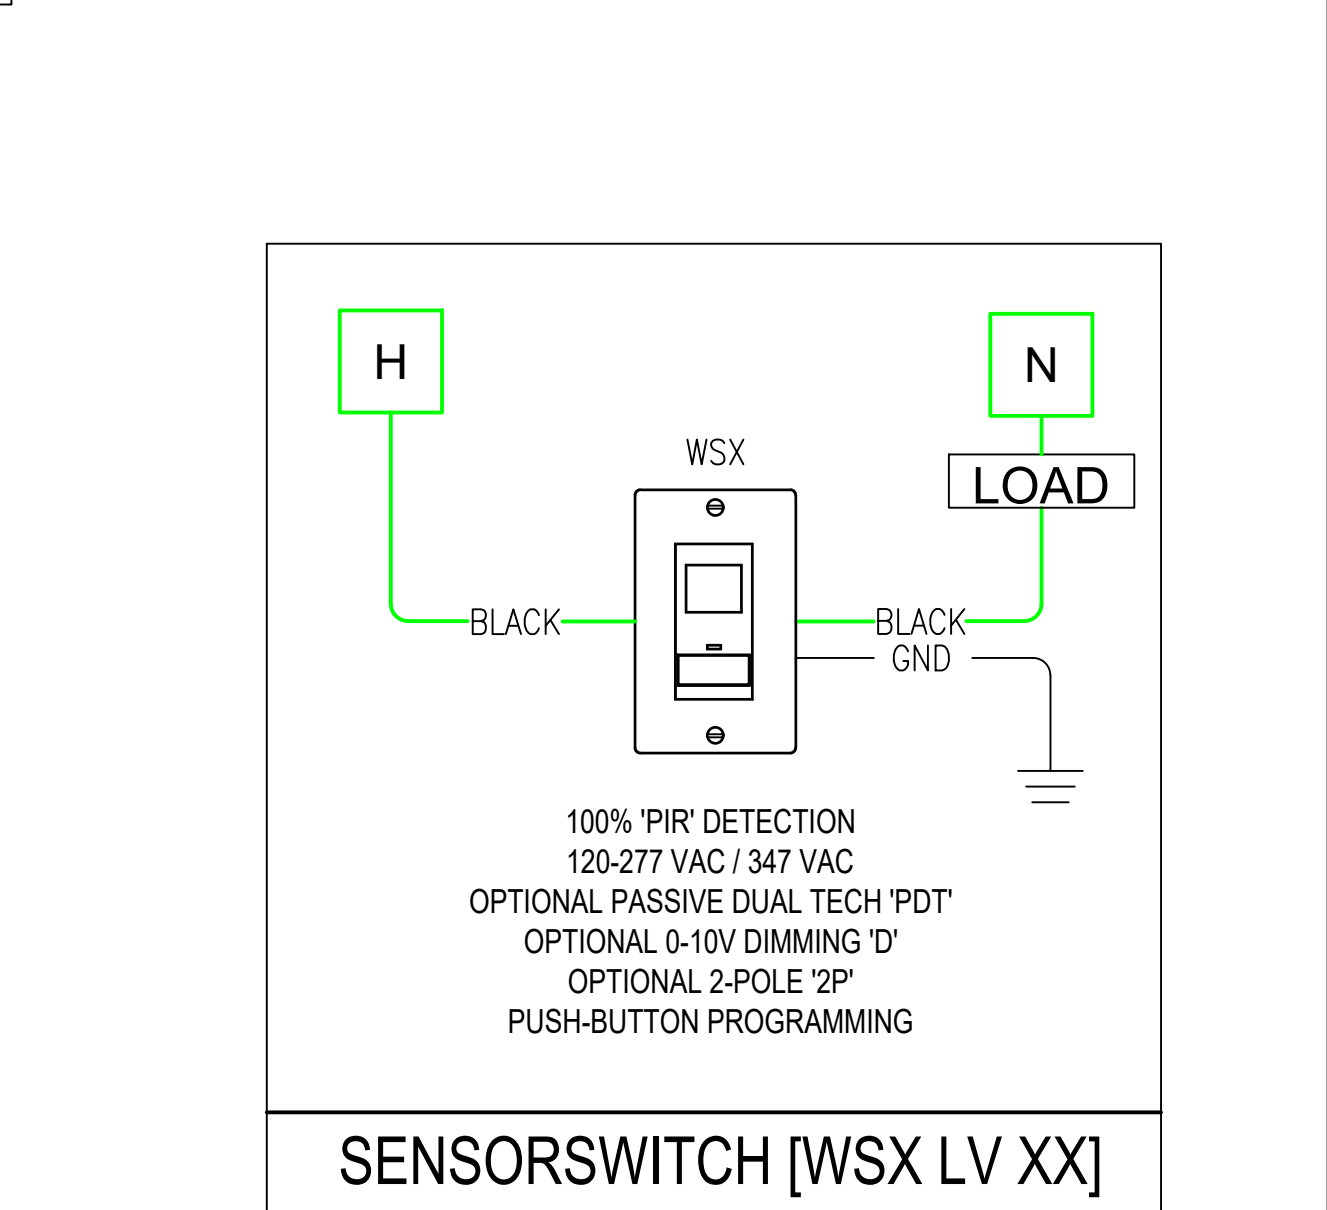

SHEET NOTES / KEY:		PROJECT:	PREPARED FOR:	SER:	SHEET:
authorized agent for the manufacturers of the products shown herein. Product application recommendations are intended solely as an application aid and are not instruments thereof. Recommendations are based on project information provided by third parties (e.g. architect). Additional or alternate requirements to meet actual project conditions at the time of design, quotation, order, and/or installation. For maximum accuracy, please verify and confirm all project details and conditions prior to commitment of any kind such as design, prioritizing, ordering, and/or installation. nLIGHT, Inc. is not responsible for any loss or damage arising from errors and/or omissions within information provided to nLIGHT, Inc. on which recommendations/advice are based and all contact herein, excepting only those specific portions thereof originating from a third party such as a design professional or manufacturer, shall remain the property of nLIGHT, Inc. who retains and reserves all rights thereto and shall not be used nor reproduced in any way without express permission of nLIGHT, Inc.		Project Name --- City, California ---	 sixteen5hundred lighting services company and manufacturer 1510 20th Street • San Jose, CA 95131 • Tel: 408.283.1650 • Fax: 408.283.1651 www.sixteen5hundred.com • www.16500.com PREPARED BY: PROJECT ID: PC# 19-XXXXXX Engineer: xxxxxxx@16500.com 510 645 25xx PRIMARY CONTACT: Sales: sales@16500.com 510 645 25xx	 nLIGHT SYSTEM DIAGRAM LC0.1	

PRIVATE OFFICE OR SIMILAR

16500 recommends printing drawings on 36" x 48" sheets and in color.
Any symbols that do not appear in the 16500 legend, are not 16500/Acuity control products.

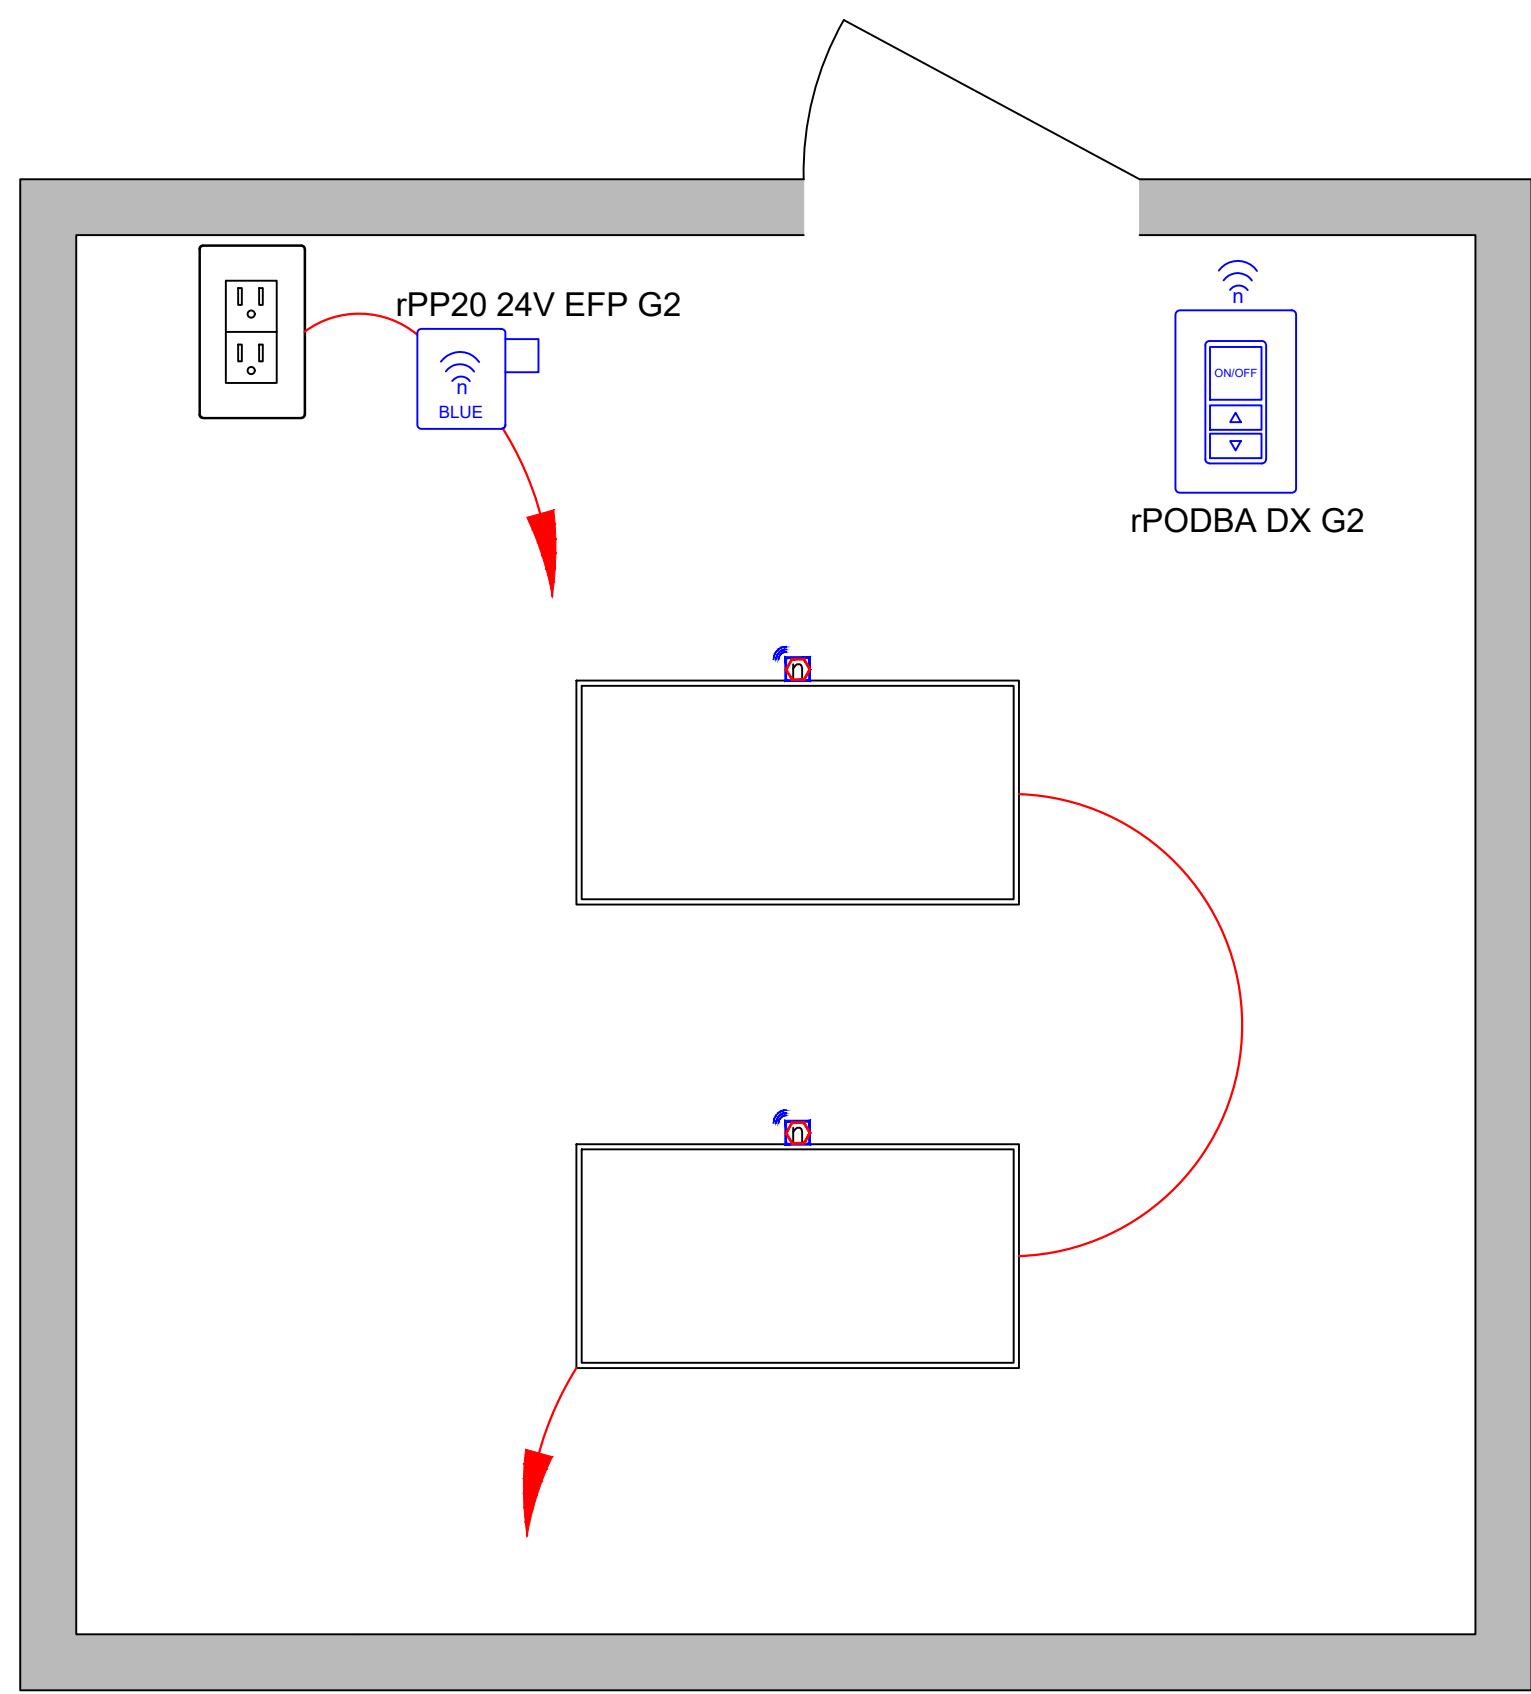


DIAGRAM LEGEND

- CAT-5e CABLE
- LINE VOLTAGE WIRES
- LINE FEED

SAMPLE SEQUENCE OF OPERATION (S.O.O.)

- PRIVATE OFFICE**
- LIGHTS**
- ALL LIGHTS ARE DIMMABLE
 - ALL FIXTURES ARE CONTROLLED TOGETHER
 - TYPICAL AUTO-ON TO 70% MAX OR MANUAL-ON AS NEEDED.
- OCCUPANCY**
- LIGHTS MUST BE TURNED ON MANUALLY (OR OPTIONALLY CAN BE CONFIGURED TO COME ON AUTOMATICALLY TO 70%)
 - PLUG LOAD TURNS ON AUTOMATICALLY
 - LIGHTS AUTOMATICALLY TURN OFF WHEN ROOM BECOMES VACANT AFTER 20 MINUTE MAXIMUM
- DAYLIGHT**
- NOT REQUIRED FOR SPACES WITHOUT WINDOWS OR THAT HAVE LOADS <120W IN DAYLIGHT ZONE.
- MANUAL**
- ON/OFF & RAISE/LOWER CONTROL OF LIGHTS
- ADDITIONAL OPTIONS:**
- ROOM CAN BE CONNECTED TO nLIGHT BACKBONE TO ENABLE NETWORK CONTROL, ADR AMONG OTHER FEATURES. SEE SPEC SHEET FOR FURTHER DETAILS.

BILL OF MATERIAL

QTY	PRODUCT #	DESCRIPTION
1	rPP20 D 24V EFP G2	PLUG LOAD RELAY PACK
1	rPODBA DX G2	BATTERY OPERATED WALL SWITCH w/ ON/OFF & RAISE/LOWER
2	WILL VARY	nLIGHT AIR ENABLED FIXTURES WITH BUILT-IN OCCUPANCY/PHOTOCELL SENSORS

nLIGHT AIR FIXTURE ENABLED APPLICATION

CONFERENCE

16500 recommends printing drawings on 36" x 48" sheets and in color.
Any symbols that do not appear in the 16500 legend, are not 16500/Acuity control products.

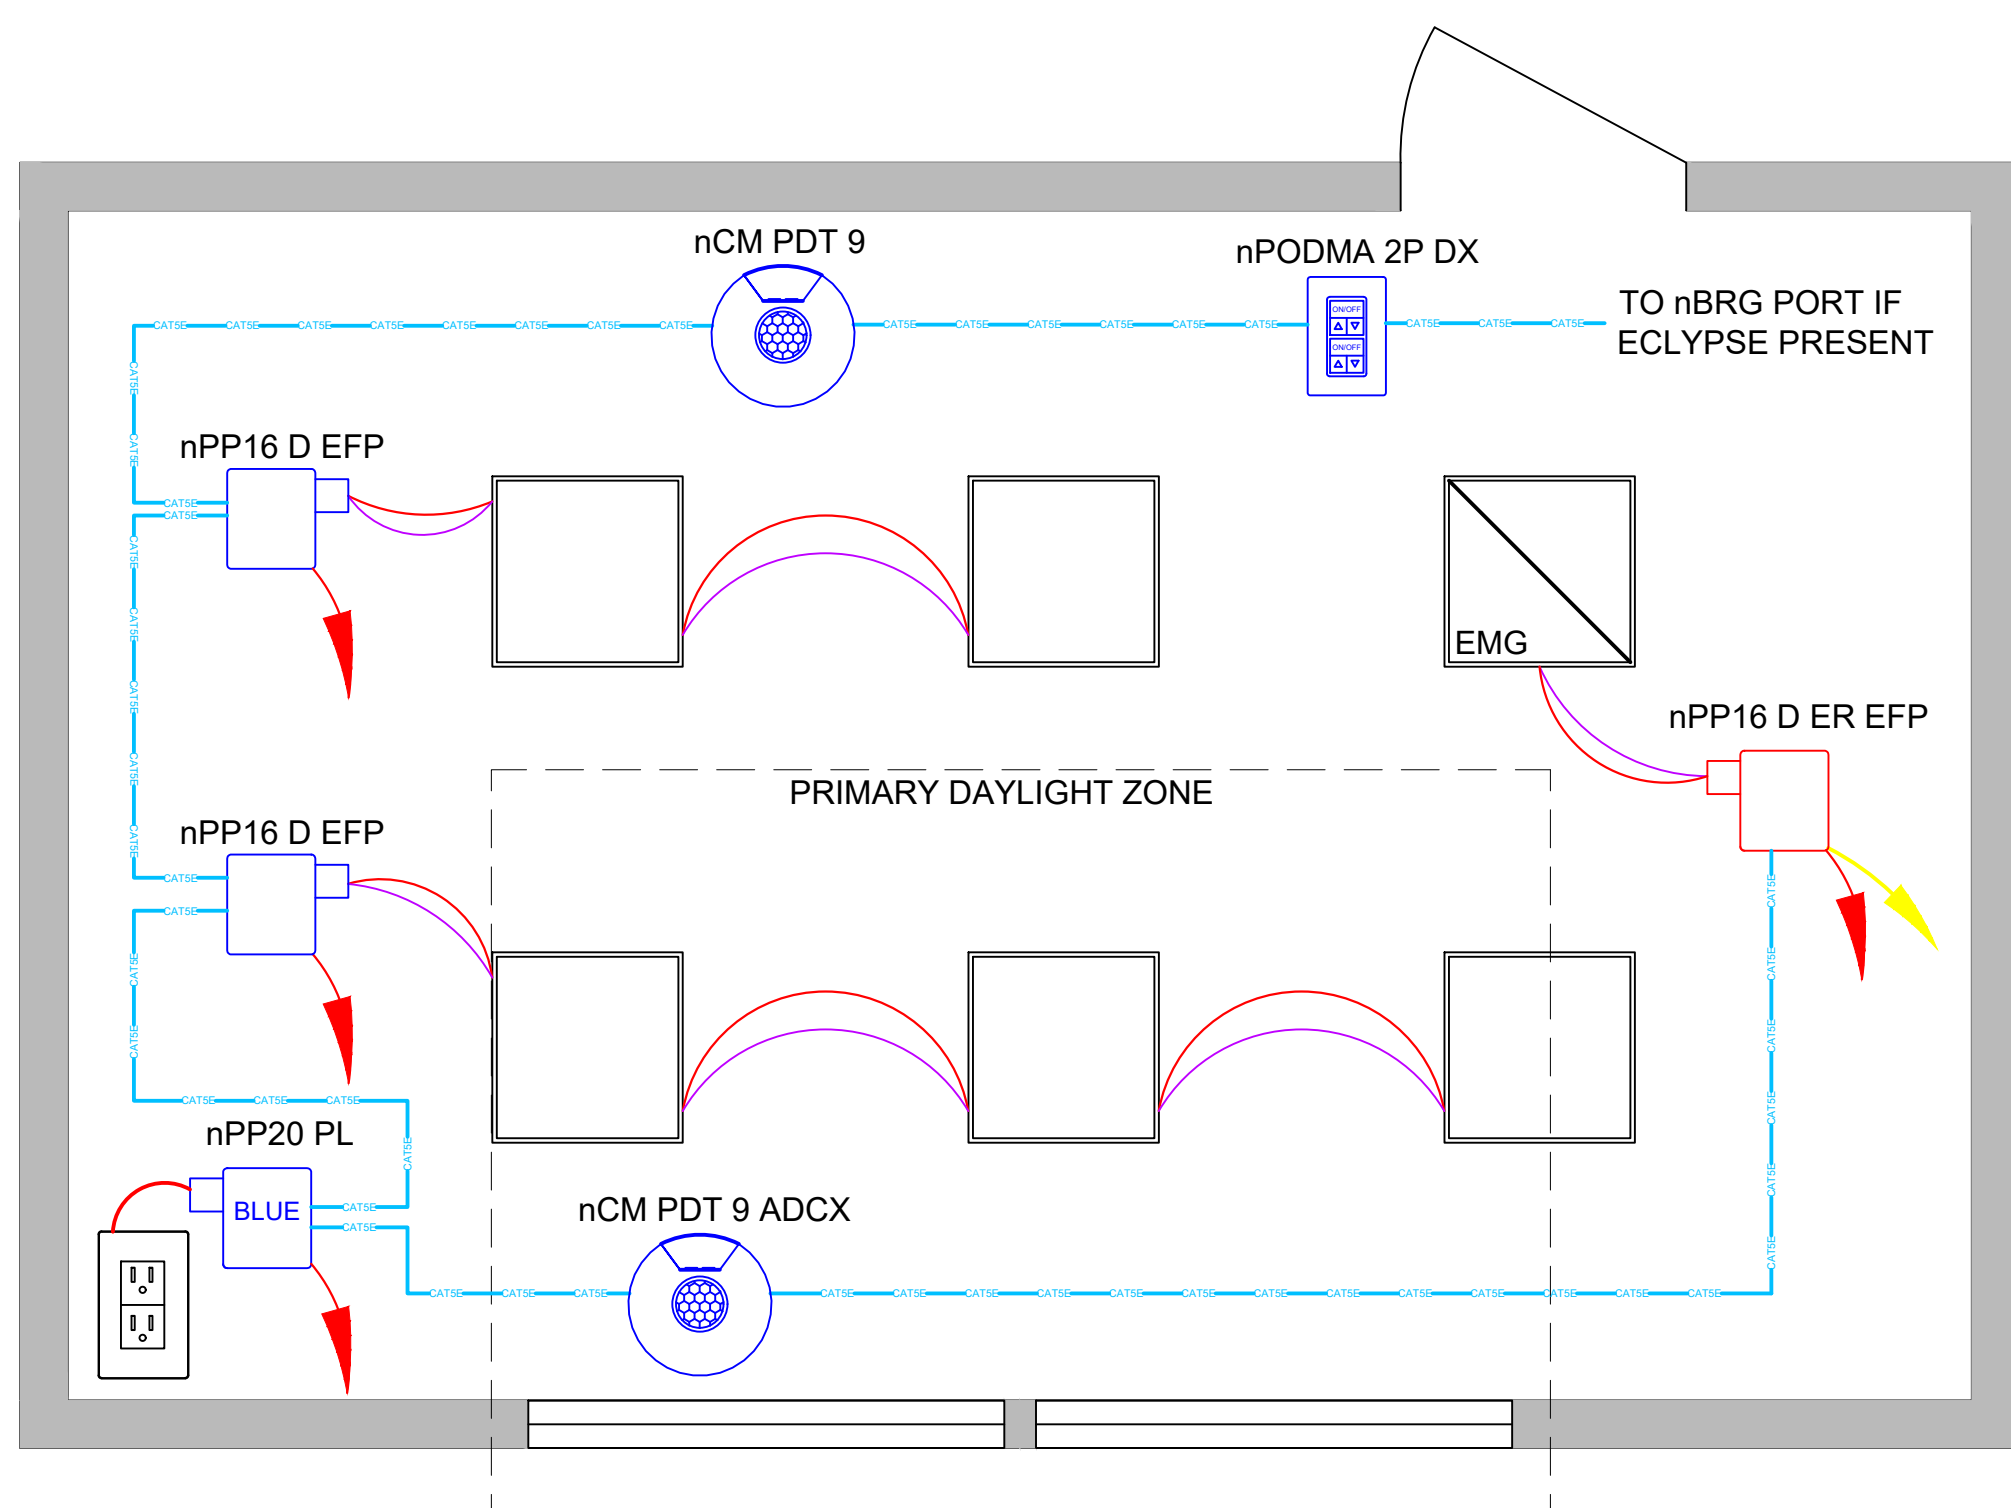


DIAGRAM LEGEND

- CAT-5e CABLE
- LINE VOLTAGE WIRES
- 0-10VDC WIRES
- LINE FEED
- EM FEED

SAMPLE SEQUENCE OF OPERATION (S.O.O.)

- CONFERENCE ROOM:**
- LIGHTS**
- ALL LIGHTS ARE DIMMABLE
 - EACH ROW CONTROLLED INDEPENDENTLY (SEE WIRING CONFIGURATION)
 - MAXIMUM LEVEL CAN BE LIMITED AS NEEDED FOR LUMEN MAINTENANCE
- OCCUPANCY**
- LIGHTS MUST BE TURNED ON MANUALLY TO FULL OR AUTO ON TO 70%
 - LIGHTS AUTOMATICALLY TURN OFF WHEN ROOM BECOMES VACANT AFTER MAXIMUM TIMEOUT OF 20 MINUTES OR LESS
 - PLUG LOAD AUTO ON/OFF PER OCCUPANCY SENSOR
- DAYLIGHT**
- SMOOTH CONTINUOUS DIMMING BASED ON DAYLIGHT CONTRIBUTION
 - RAMP TIME MAY BE ADJUSTED AS NEEDED
 - SEE T24 STANDARDS FOR FURTHER INFORMATION ON DAYLIGHT ZONES
- MANUAL**
- ON/OFF & RAISE/LOWER CONTROL OF EACH ROW INDEPENDENTLY
- ADDITIONAL OPTIONS:**
- SURFACE OR RECESSED MOUNT SENSORS ALSO AVAILABLE
 - ROOM CAN BE CONNECTED TO nLIGHT BACKBONE TO ENABLE NETWORK CONTROL OR ADR (AUTOMATIC DEMAND RESPONSE)

BILL OF MATERIAL

QTY	PRODUCT #	DESCRIPTION
2	nPP16 D EFP	RELAY MODULE WITH 0-10V DIMMING OUTPUT
1	nPP16 D ER EFP	EMERGENCY RELAY MODULE WITH 0-10V DIMMING OUTPUT
1	nPP20 PL	PLUG LOAD RELAY PACK
1	nPODMA 2P DX	DUAL ON/OFF & RAISE/LOWER WALL POD
1	nCM PDT 9	DUAL TECHNOLOGY OCCUPANCY SENSOR
1	nCM PDT 9 ADCX	DUAL TECHNOLOGY OCCUPANCY SENSOR WITH PHOTOCELL

nLIGHT WIRED EXTERNAL APPLICATION

RESTROOM

16500 recommends printing drawings on 36" x 48" sheets and in color.
Any symbols that do not appear in the 16500 legend, are not 16500/Acuity control products.

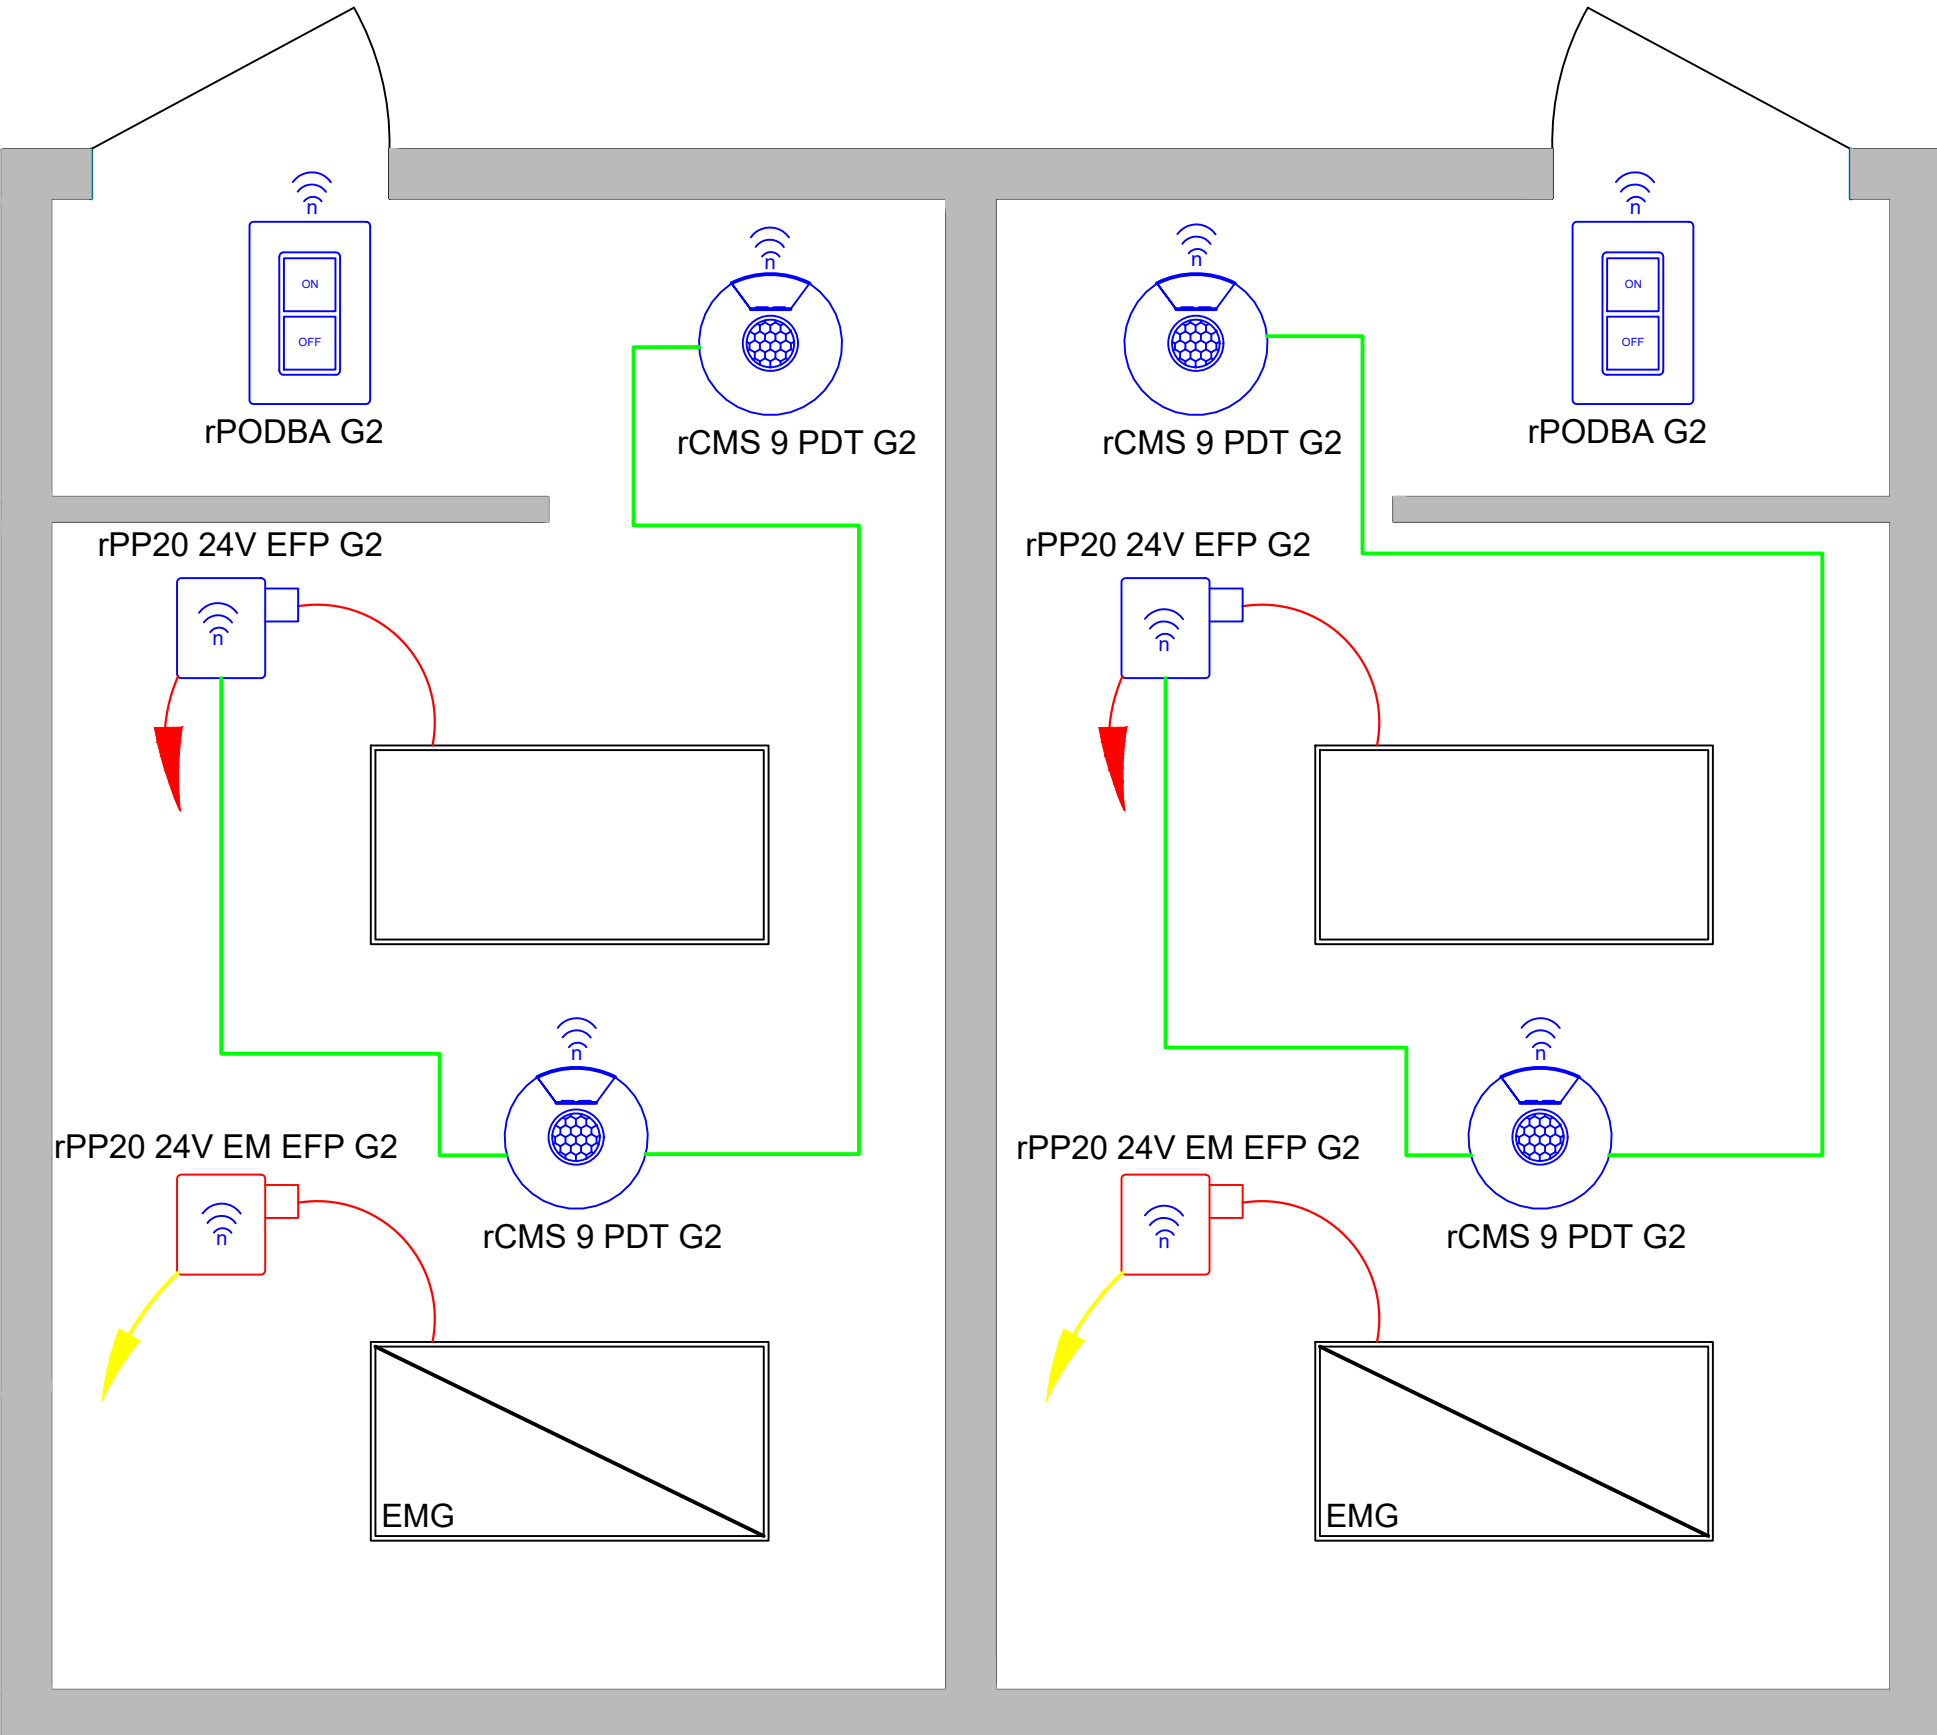


DIAGRAM LEGEND

- CAT-5e CABLE
- LINE VOLTAGE WIRES
- 0-10VDC WIRES
- LOW VOLTAGE (24V) WIRES
- LINE FEED
- EM LINE FEED

SAMPLE SEQUENCE OF OPERATION (S.O.O.)

- MULTI-STALL RESTROOM:**
- LIGHTS**
- ALL FIXTURES ARE CONTROLLED TOGETHER IN SINGLE GROUP
 - DIMMING EXEMPT PER 2019 TITLE 24 STANDARD FOR ROOM-TYPE (RESTROOM)
- OCCUPANCY**
- LIGHTS AUTOMATICALLY TURN ON WHEN OCCUPANT ENTERS
 - LIGHTS AUTOMATICALLY TURN OFF WHEN ROOM BECOMES VACANT AFTER 20 MINUTE MAXIMUM OR LESS
- MANUAL**
- MASTER ON/OFF CONTROL OF LIGHTS
- ADDITIONAL OPTIONS:**
- ROOM CAN BE CONNECTED TO nLIGHT BACKBONE TO ENABLE NETWORK CONTROL, ADR AMONG OTHER FEATURES. SEE SPEC SHEET FOR FURTHER DETAILS.

BILL OF MATERIAL

QTY	PRODUCT #	DESCRIPTION
1	rPP20 24V EFP G2	RELAY MODULE FOR ON/OFF ONLY + 24V LOW VOLTAGE POWER
1	rPP20 24V EM EFP G2	EMERGENCY RELAY MODULE
1	rPODBA G2	BATTERY OPERATED WALL SWITCH w/ ON/OFF
2	rCMS 9 PDT G2	LOW-VOLTAGE (24V) 'PIR' + 'PDT' OCCUPANCY SENSOR

nLIGHT AIR EXTERNAL APPLICATION

CORRIDOR

16500 recommends printing drawings on 36" x 48" sheets and in color.
Any symbols that do not appear in the 16500 legend, are not 16500/Acuity control products.

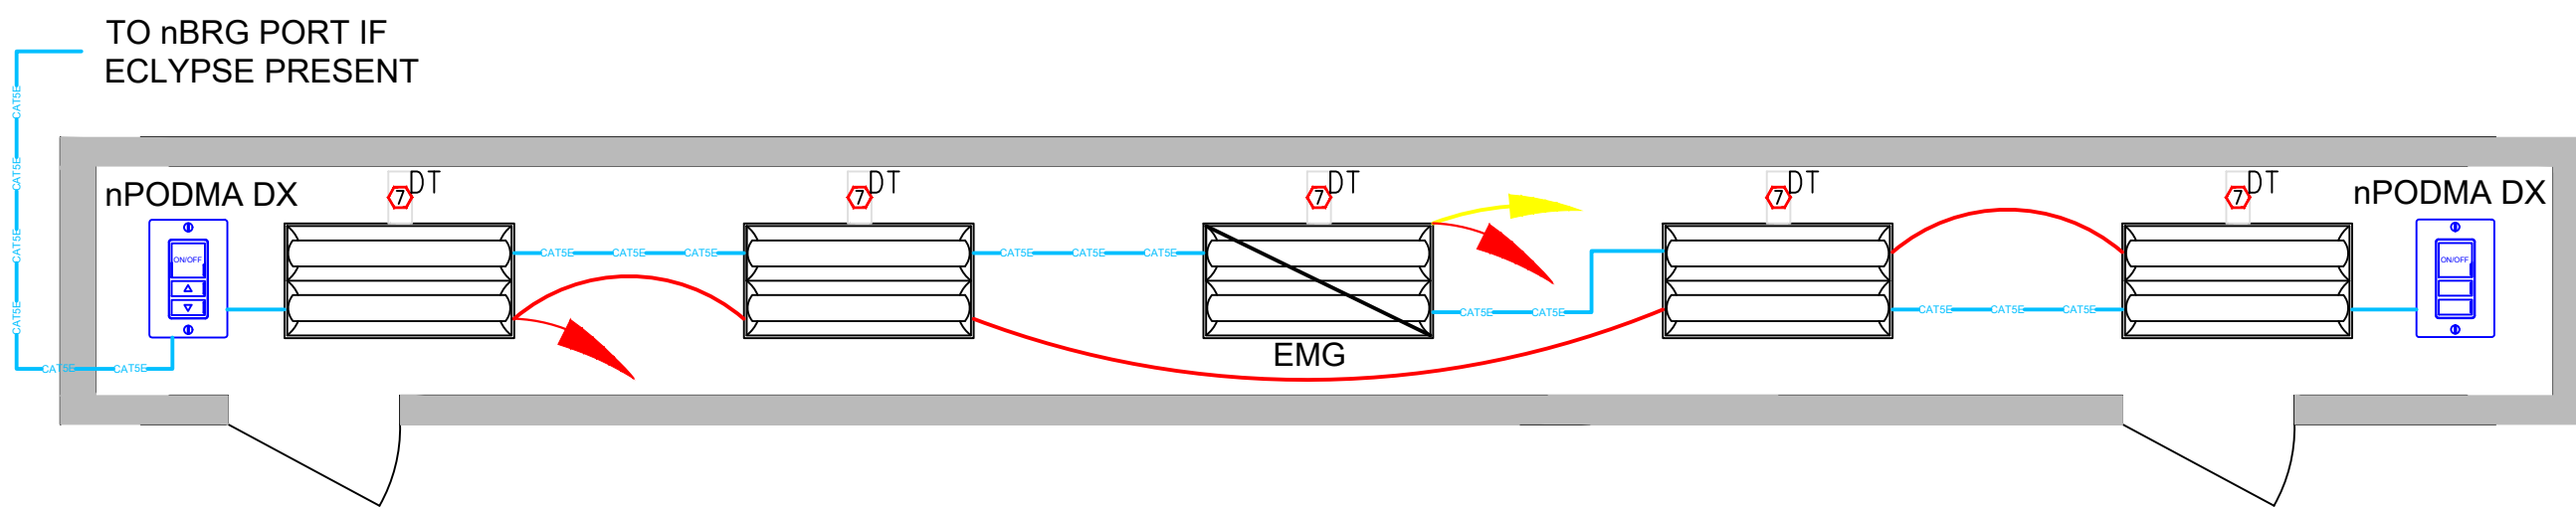


DIAGRAM LEGEND

- CAT-5e CABLE
- LINE VOLTAGE WIRES
- LINE FEED
- EM FEED

SAMPLE SEQUENCE OF OPERATION (S.O.O.)

- CORRIDOR/HALLWAY:**
- LIGHTS**
- ALL LIGHTS ARE DIMMABLE
 - ALL FIXTURES CONTROLLED TOGETHER AS SINGLE GROUP
 - LIGHTING OUTPUT CAN BE LIMITED AS NEEDED FOR OPTIONAL LUMEN COMPENSATION
- OCCUPANCY**
- LIGHTS AUTOMATICALLY GO TO FULL BRIGHT WHEN OCCUPIED
 - LIGHTS AUTOMATICALLY TURN OFF OR DROP TO OPTIONAL LOW DIM SETTING WHEN SPACE BECOMES VACANT
- MANUAL**
- MASTER ON/OFF & RAISE/LOWER CONTROL OF ENTIRE SPACE
- ADDITIONAL OPTIONS:**
- SURFACE OR RECESSED MOUNT SENSORS ALSO AVAILABLE
 - SPACE / ZONE CAN BE CONNECTED TO nLIGHT BACKBONE TO ENABLE NETWORK CONTROL OR ADR (AUTOMATIC DEMAND RESPONSE)

BILL OF MATERIAL

QTY	PRODUCT #	DESCRIPTION
2	nPODMA DX	DUAL ON/OFF & RAISE/LOWER WALL POD
4	WILL VARY	nLIGHT ENABLED FIXTURES WITH BUILT-IN OCCUPANCY/PHOTOCELL SENSORS

nLIGHT WIRED FIXTURE ENABLED APPLICATION

MULTI-PURPOSE OR SIMILAR + THIRD PARTY INTERFACE

16500 recommends printing drawings on 36" x 48" sheets and in color.
Any symbols that do not appear in the 16500 legend, are not 16500/Acuity control products.

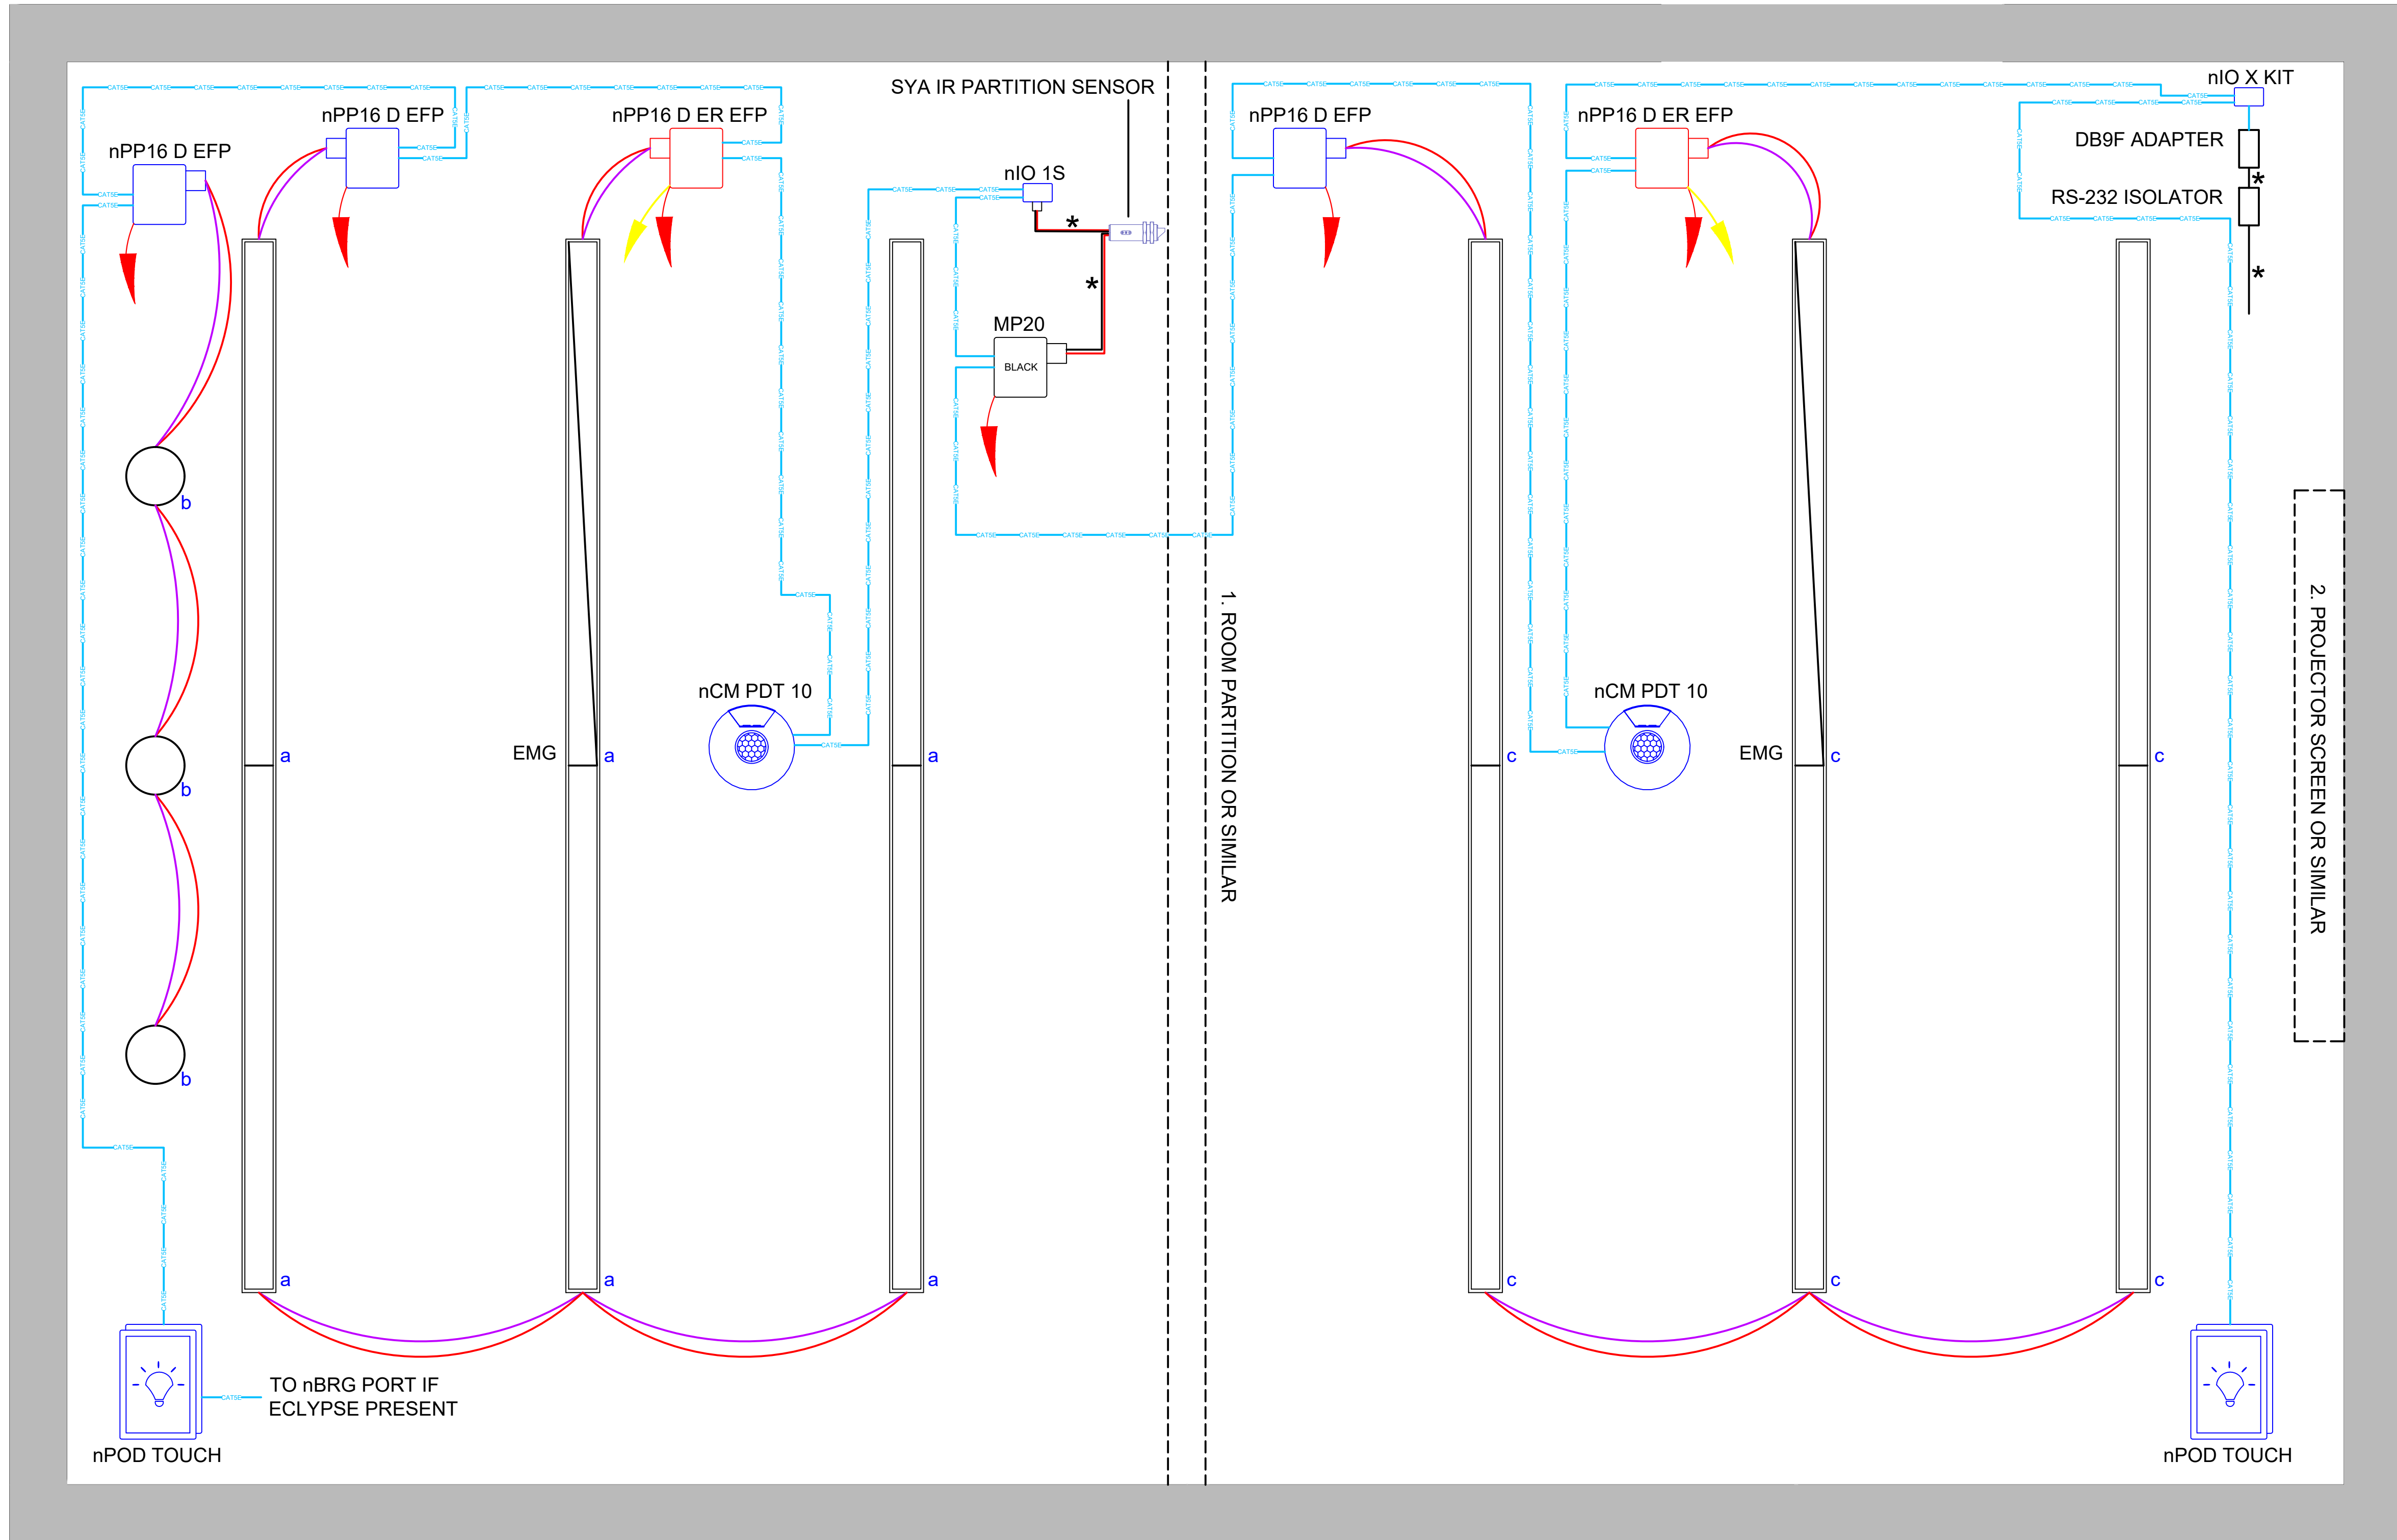


DIAGRAM LEGEND

- CAT-5e CABLE
- LINE VOLTAGE WIRES
- 0-10VDC WIRES
- LINE FEED
- EM FEED
- SEE DEVICE SPEC SHEET FOR FURTHER WIRING DETAIL

SAMPLE SEQUENCE OF OPERATION (S.O.O.)

CONFERENCE ROOM:

- LIGHTS**
- ALL LIGHTS ARE DIMMABLE
 - EACH GROUP (a,b,c) CONTROLLED INDEPENDENTLY
 - MAXIMUM LEVEL CAN BE LIMITED TO 80%
 - OPTIONAL AUTOMATIC LUMEN COMPENSATION
- OCCUPANCY**
- LIGHTS MUST BE TURNED ON MANUALLY (OR CAN BE RECONFIGURED TO BE AUTO ON TO 50%)
 - LIGHTS AUTOMATICALLY TURN OFF WHEN ROOM BECOMES VACANT
- DAYLIGHT**
- NOT INCLUDED IN PRESENT SCENARIO

- MANUAL**
- (2) nPOD TOUCH GRAPHIC WALLPODS PROVIDED ON EITHER SIDE OF PARTITIONED ZONES
 - ON/OFF & RAISE/LOWER & SCENE CONTROL OF EACH GROUP INCLUDING THIRD-PARTY INTERFACES (SEE ADDITIONAL OPTIONS)
 - WHEN PARTITION OPEN, BOTH nPOD TOUCH TO CONTROL BOTH PARTITION ZONES. WHEN PARTITION CLOSED, EACH nPOD TOUCH TO ONLY CONTROL RESPECTIVE ZONE

- ADDITIONAL OPTIONS:**
- CONNECTION TO THIRD-PARTY DEVICES HAVE BEEN INCLUDED FOR REFERENCE.
 - ROOM PARTITION OR SIMILAR (P/N: nIO X KIT)
 - PROJECTOR SCREEN OR SIMILAR (P/N: nIO 1S + SYA IR PARTITION SENSOR)
- PLEASE REFER TO DEVICE SPEC SHEETS FOR FURTHER DETAILS AND CAPABILITIES
- ROOM CAN BE CONNECTED TO nLIGHT BACKBONE TO ENABLE NET-WORK CONTROL OR ADR (AUTOMATIC DEMAND RESPONSE)

BILL OF MATERIAL

QTY	PRODUCT #	DESCRIPTION
3	nPP16 D EFP	RELAY MODULE WITH 0-10V DIMMING OUTPUT
2	nPP16 D ER EFP	EMERGENCY RELAY MODULE WITH 0-10V DIMMING OUTPUT
2	nPOD TOUCH	GRAPHIC INTERFACE MANUAL CONTROLLER
2	nCM PDT 10	DUAL TECHNOLOGY EXTENDED RANGE OCCUPANCY SENSOR
1	nIO 1S KO	DIGITAL INTERFACE TO THIRD PARTY DEVICES
1	MP20	POWER PACK FOR LOW VOLTAGE DEVICES
1	SYA IR	PARTITION SENSOR (MODEL MAY VARY)
1	nIO X KIT	DIGITAL INTERFACE WITH RS-232 OR RS-485 OUTPUTS

nLIGHT WIRED EXTERNAL APPLICATION

16500 SAMPLE LIGHTING CONTROLS SEQUENCE OF OPERATION "S.O.O."










NOTE: SAMPLE SEQUENCE OF OPERATION "S.O.O." SHOWN USED FOR REFERENCE ONLY.
IF A PROJECT SPECIFIC S.O.O. IS NOT PROVIDED TO 16500 BY THE SUBMITTER, THE SUBMITTER SHALL BE RESPONSIBLE FOR PROVIDING THE S.O.O. TO 16500.
SUBMITTAL DRAWING SET: 16500 WILL ASSUME ONE IS NOT AVAILABLE AND
WILL UTILIZE THE 16500 SAMPLE S.O.O. FOR PROGRAMMING PURPOSES. DEVIATION
FROM THE SAMPLE S.O.O. IS DEEMED POST START UP / PROGRAMMING. THEN ADDITIONAL
CONTROL SERVICES WILL NEED TO BE PURCHASED DUE TO
NEW PROGRAMMING INTENT.

AREA TYPE	OCCUPANCY SENSOR					TIME CLOCK		MANUAL CONTROL				DAYLIGHT		OTHER				NOTES & COMMENTS
	AUTO ON FULL (100%)	AUTO ON PARTIAL (50-75%)	MANUAL ON FULL (100%)	SENSOR TIME-OUT (% MAY VARY)	PARTIAL OFF (BEST PRACTICE) [3]	SCHEDULED ON (2 HOUR MAX)	SCHEDULED OFF (2 HOUR MAX)	ON/OFF ONLY	BI-LEVEL DIMMING (100% ON/OFF)	CONTINUOUS MANUAL DIMMING SWITCH	UNACCESSIBLE TO PERSONS	SCENE SWITCH [2]	CONTINUOUS DIMMING	PHOTOCELL SHUTOFF (AM, SHADY, ETC.)	PLUG LOAD CONTROL RESPONSE (AUX)	AUTOMATIC DEMAND RESPONSE (AUX)	CIRCUITRY RHYTHM (1%)	
EXAMPLE																		
OPEN OFFICE		X[5]	X[5]	15		X[5]	X	X										
PRIVATE OFFICE OR SIMILAR [7]		X		15		X	X											
CONFERENCE		X		10		X	X											
CORRIDOR/STAIR/CIRCULATION	X	X	X	15	X	X	X		X	X								
RECEPTION LOBBY		X	X	15	X	X	X		X	X								
PARKING GARAGE (INTERIOR)	X	X		15	X	X	X		X	X								
STORAGE OR SIMILAR [9]		X		10		X	X	X		X	X							
WAREHOUSE	X			15	X	X	X		X									
WAREHOUSE AISLE	X			15	X	X	X		X									
COPY ROOM		X[5]		10		X	X		X									
MULTI-PURPOSE ROOM		X[5]	X[5]	15	X[5]	X	X		X									
RESTROOM [9]	X			10/15		X	X	X		X[9]								
CLASSROOM		X	X	15		X	X				X	X						
EXTERIOR W/ PHOTOCELL ONLY					X									X				
EXTERIOR W/ TIMECLOCK ONLY					X	X		X										
EXTERIOR W/ OCCUPANCY [6]	X			15	X													
[10]																		

NOTES:
[1] WHERE APPLICABLE EITHER AUTO ON PARTIAL OR MANUAL ON MAY BE SELECTED.
[2] AS MUCH AS 10% TIME-OUT IS ALLOWED FOR INTERIOR. IF ANY ON EXTERIOR SPACES IT MAY BE BEST PRACTICE TO SELECT SPACES FOR LESS IN ORDER TO MAXIMIZE ENERGY SAVINGS.
[3] IS SCHEDULED ON OPERATION MAY ONLY BE APPLIED TO SPACES EXCEPT FROM OCCUPANCY SENSOR CONTROL. (E. TIMECLOCK ONLY).
[4] SCENE SWITCH RECOMMENDED TO SELECT SPACES BASED ON BEST PRACTICE.
[5] TITLE IN REQUIREMENTS MAY VARY IN RESPECTIVE SPACE TYPE BASED ON SQUARE FOOTAGE (EXAMPLE: OPEN OFFICE > 1 = 20 SQFT).
[6] OCCUPANCY SENSORS MAY BE REQUIRED IN ADDITION TO PHOTOCELL/TIMECLOCK IN ROOMS 14' OR BELOW IF AND FUTURE EXCESS AWA.
[7] SINGLE ROOM TYPES MAY INCLUDE PHONE ROOM, AUDIO ROOM, ETC.
[8] SINGLE ROOM TYPES MAY INCLUDE JANITOR, E. ELECTRICAL, SINGLE STALL PRIVATE RESTROOM, ETC.
[9] TITLE IN REQUIREMENTS AND DEFAULT SETTINGS MAY VARY BASED ON RESTROOM SIZE (PRIVATE, SINGLE-STALL, MULTI-STALL, ETC.).
[10] INCLUDE ADDITIONAL SPACES/REQUIREMENTS AS NEEDED.

IF COMMENTS/EDITS MADE TO TEMPLATE ABOVE PLEASE INCLUDE THE FOLLOWING:

EDITED BY					
COMPANY					
DATE					

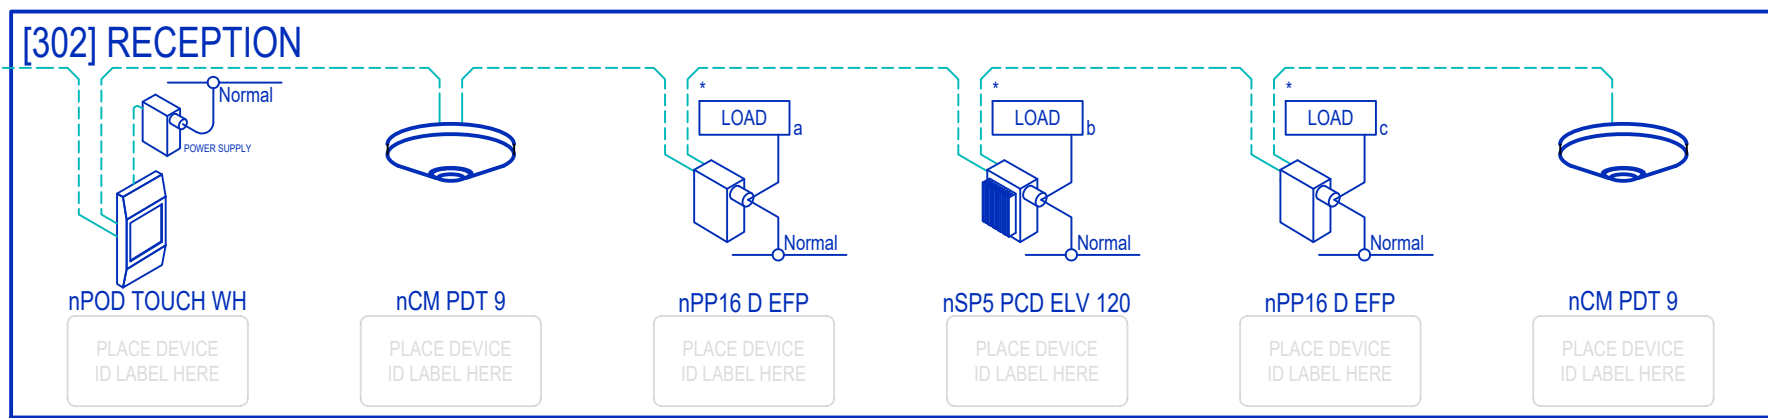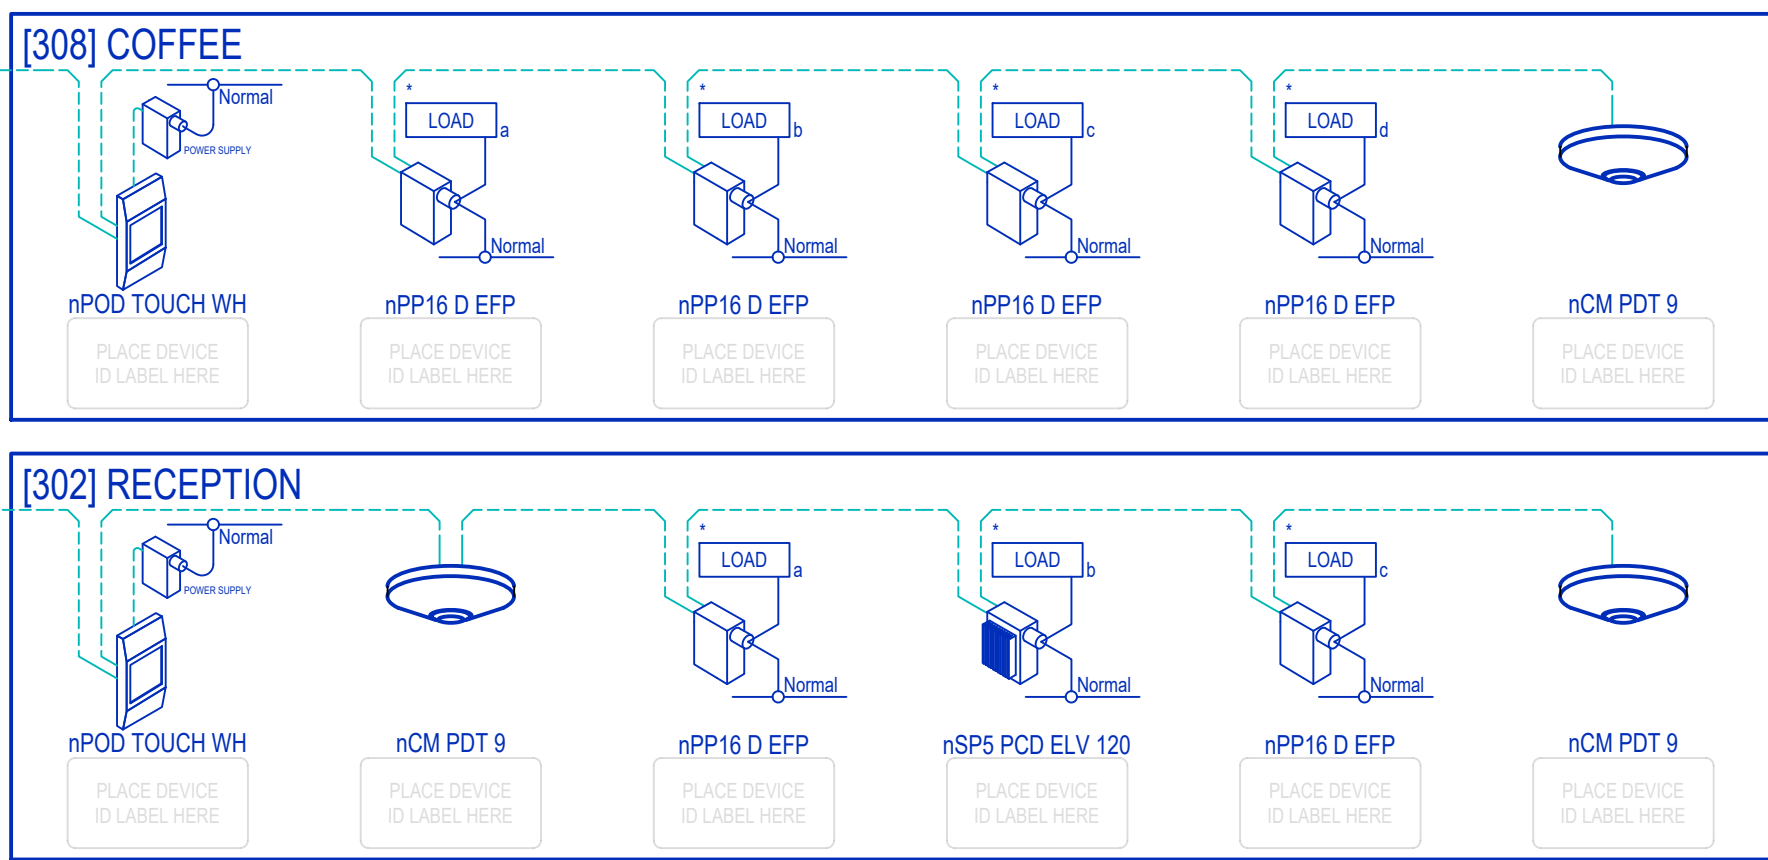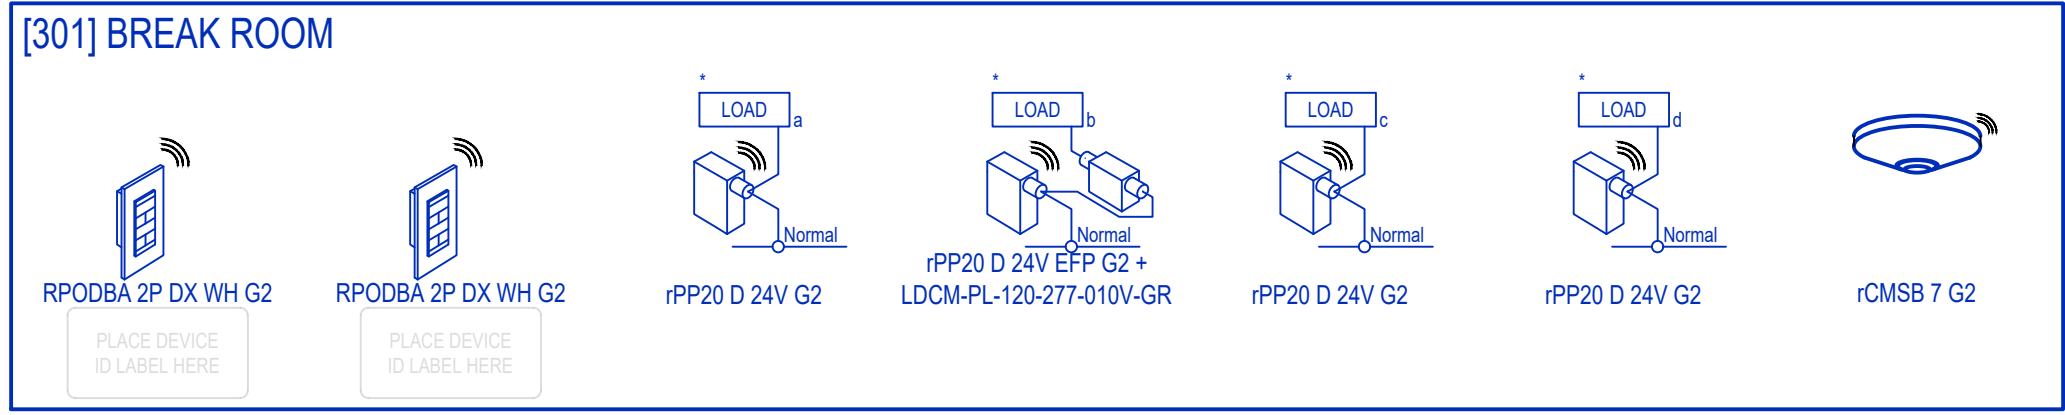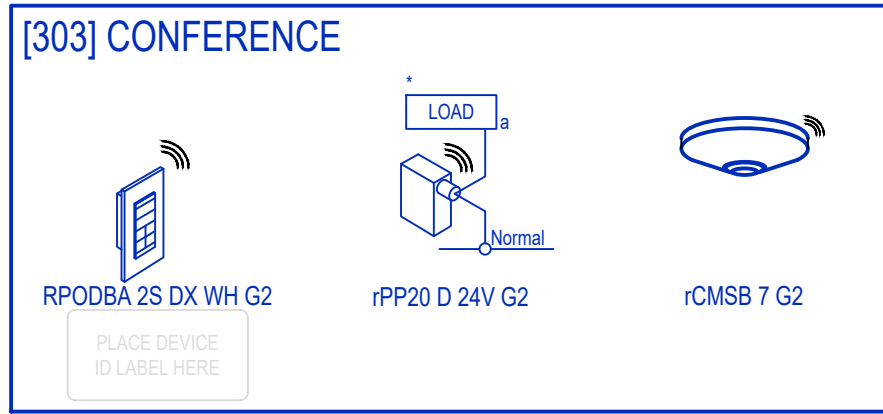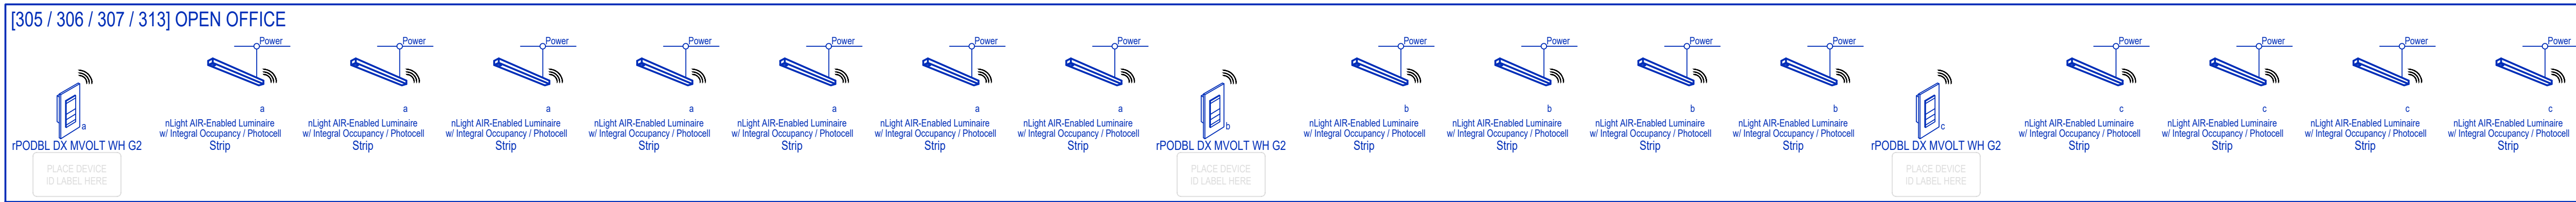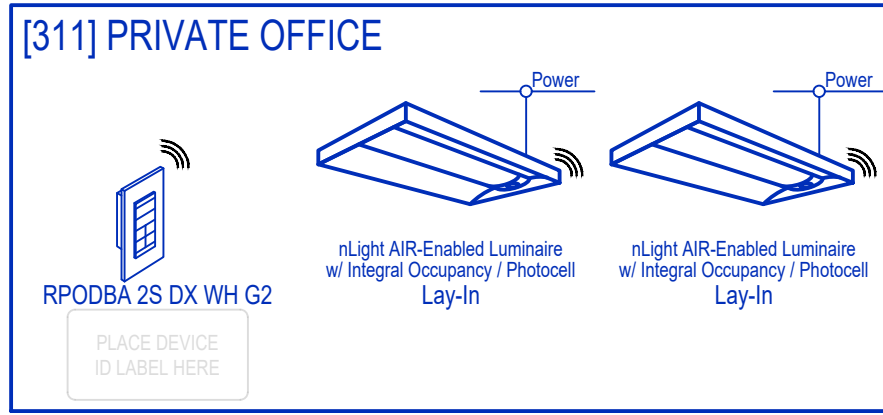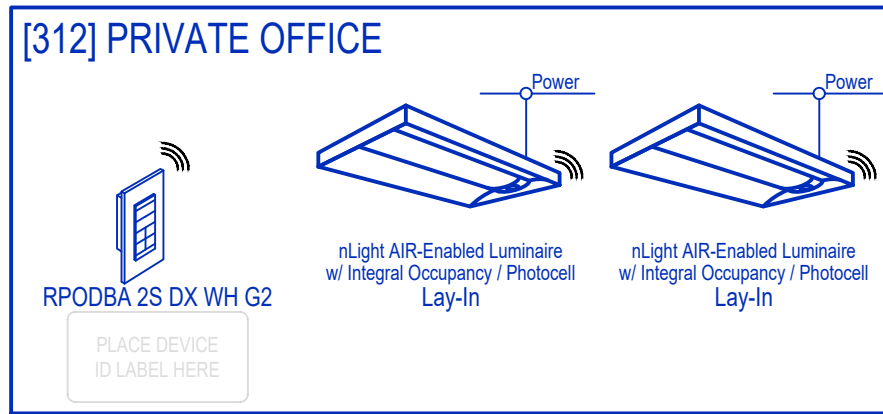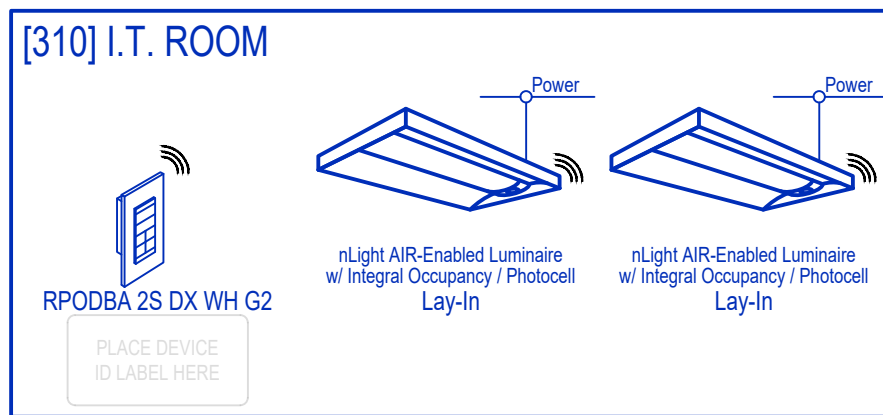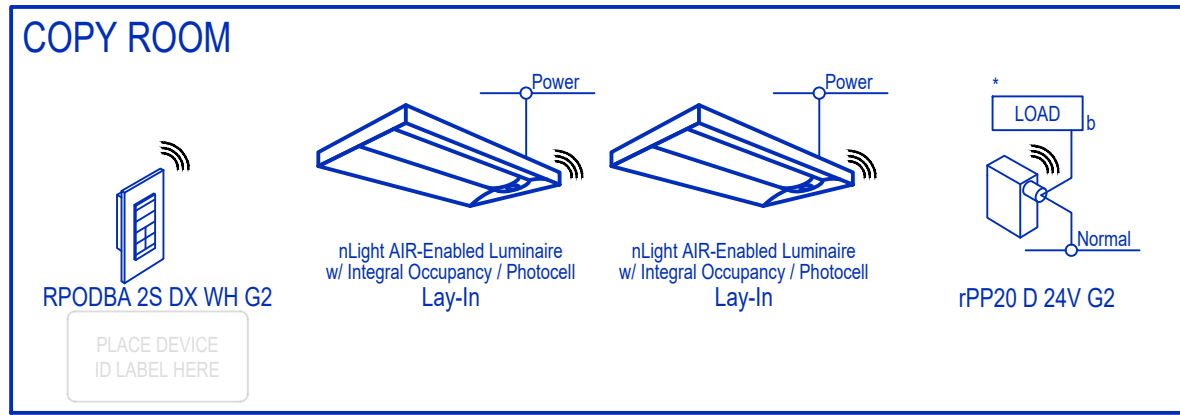

16500, Inc. is an authorized agent for the manufacturers of the products shown herein. Product application recommendations are intended solely as an application and not as professional service or instruments thereof. Recommendations are based on project information provided by third parties (e.g. architect). Additional or alternate products may be required to meet actual project conditions at the time of design, quotation, order, and/or installation. For maximum accuracy, please verify and communicate all relevant application conditions prior to commitment of any kind such as design, pricing/quoting, ordering, and/or installation. 16500, Inc. is not responsible and shall not be held liable for losses/damages arising from errors and/or omissions within information provided to 16500, Inc. on which recommendations/quotations are based. This document and all content herein, excepting only those specific portions thereof originating from a third party such as a design professional or manufacturer, are the sole property of 16500, Inc. who retains and reserves all rights thereto and shall not be used and/or possessed in any way by others without express permission from 16500, Inc.

DIRECT NOTES / REV

PROJECT

Project Name
City, California

PREPARED FOR

DATE

16500
LIGHTING
SOLUTIONS

sixteen5hundred
Lighting / Lighting Controls / Energy Management Solutions
510.268.6085 * 16500@16500.com * www.16500.com
PROJECT ID: PCH-19-XXXXXX
xxxxxx@16500.com 510.645.25xx
sales@16500.com 510.645.25xx

nLIGHT SYSTEM
DIAGRAM
LCB1

ISSUE / REVISION	DATE
1 - PROPOSAL	XXXXXX